



NEMO|etc.

Certificate of Authorization #32455
353 Christian Street, Unit #13
Oxford, CT 06478
(203) 262-9245

ENGINEER

EVALUATE

TEST

CONSULT

EVALUATION REPORT

Duro-Last Roofing, Inc.
525 Morley Drive
Saginaw, MI 48601
(800) 248-0280

Evaluation Report D9750.05.08-R11
FL1559-R14
Date of Issuance: 05/22/2008
Revision 11: 07/14/2020

SCOPE:

This Evaluation Report is issued under **Rule 61G20-3** and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code. The product described herein has been evaluated for compliance with the **7th Edition (2020) Florida Building Code** sections noted herein.

DESCRIPTION: Duro-Last Single Ply Roof Systems

LABELING: Labeling shall be in accordance with the requirements of the Accredited Quality Assurance Agency noted herein.

CONTINUED COMPLIANCE: This Evaluation Report is valid until such time as the named product(s) changes, the referenced Quality Assurance or production facility location(s) changes, or Code provisions that relate to the product(s) change. Acceptance of our Evaluation Reports by the named client constitutes agreement to notify NEMO ETC, LLC of any changes to the product(s), the Quality Assurance or the production facility location(s). NEMO ETC, LLC requires a complete review of its Evaluation Report relative to updated Code requirements with each Code Cycle.

ADVERTISEMENT: The Florida Product Approval Number (FL#) preceded by the words "NEMO|etc. Evaluated" may be displayed in advertising literature. If any portion of the Evaluation Report is displayed, then it shall be done in its entirety.

INSPECTION: Upon request, a copy of this entire Evaluation Report shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This Evaluation Report consists of pages 1 through 5, plus a 47-page Appendix.

Prepared by:

Robert J.M. Nieminen, P.E.
Florida Registration No. 59166, Florida DCA ANE1983



The facsimile seal appearing was authorized by Robert Nieminen, P.E. on 07/14/2020. This does not serve as an electronically signed document.

CERTIFICATION OF INDEPENDENCE:

1. NEMO ETC, LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO ETC, LLC is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the evaluation reports are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this Evaluation Report, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

ROOFING SYSTEMS EVALUATION:
1. SCOPE:

Product Category: Roofing
Sub-Category: Single Ply Roof Systems
Compliance Statement: Duro-Last Single Ply Roof Systems, as produced by the Duro-Last Roofing, Inc., have demonstrated compliance with the following sections of the **7th Edition (2020) Florida Building Code** through testing in accordance with the following Standards. Compliance is subject to the Installation Requirements and Limitations / Conditions of Use set forth herein.

2. STANDARDS:

Section	Property	Standard	Year
1504.3.1	Wind resistance	FM 4474	2011
1504.3.1	Wind resistance	UL 1897	2012
1504.6	Physical properties	ASTM G154	2012
1504.6	Physical properties	ASTM G155	2013
1504.7	Impact resistance	FM 4470, Section 4.6	2016
1507.13.2	Material standard	ASTM D4434	2012
1523.6.2	Wind resistance	TAS 114	2011

3. REFERENCES:

Entity	Examination	Reference	Date
ACRC (TST4671)	TAS 114(D)	19-007	09/18/2019
ACRC (TST4671)	TAS 114(D)	19-008	09/18/2019
ACRC (TST4671)	TAS 114(D)	19-009	09/18/2019
ACRC (TST4671)	TAS 114(D)	19-010	09/18/2019
ACRC (TST4671)	TAS 114(D)	19-011	09/20/2019
ACRC (TST4671)	TAS 114(D)	19-012	09/20/2019
ACRC (TST4671)	TAS 114(D)	19-013	09/23/2019
ACRC (TST4671)	TAS 114(D)	19-014	09/23/2019
ACRC (TST4671)	TAS 114(D)	19-015	09/24/2019
ACRC (TST4671)	TAS 114(D)	19-016	09/24/2019
ACRC (TST4671)	TAS 114(D)	19-017	09/25/2019
ERD (TST6049)	FM 4474	02733.01.05-1	01/21/2005
ERD (TST6049)	FM 4474	02737.03.05-1	03/21/2005
ERD (TST6049)	FM 4474	02743.04.06-R1	06/13/2006
ERD (TST6049)	FM 4474	02744.05.06	05/17/2006
ERD (TST6049)	FM 4474	D6760.08.07	08/01/2007
ERD (TST6049)	FM 4474	P12200.10.08	10/14/2008
ERD (TST6049)	FM 4474	02762.03.05-R2	04/01/2010
ERD (TST6049)	FM 4474	D35320	04/20/2011
ERD (TST6049)	FM 4474	D42320.08.12	08/31/2012
ERD (TST6049)	FM 4474	D41660SC	09/27/2012
ERD (TST6049)	FM 4474	D43030SC	09/28/2012
ERD (TST6049)	FM 4474	D42390.10.12	10/03/2012
ERD (TST6049)	FM 4474	D42320.11.12	11/30/2012
ERD (TST6049)	FM 4474	D41660.11.12-R1	12/12/2012
ERD (TST6049)	ASTM D4434	D35210.08.11-R3	03/25/2013
ERD (TST6049)	FM 4474	SFS-SC10010.02.16-R1	07/06/2016
ERD (TST6049)	ASTM D4434	DL-SC13445.02.17	02/17/2017
ERD (TST11294)	FM 4474	14325.07.17-3	07/20/2017
ERD (TST6049)	Tensile Adhesion	ICP-SC15630.09.17	09/06/2017
ERD (TST6049)	Tensile Adhesion	ICP-SC16225.09.17	09/06/2017
FM Approvals (TST1867)	FM 4470	2M4A8.AM	03/05/1987
FM Approvals (TST1867)	FM 4470	3Y5A6.AM	03/10/1995

<u>Entity</u>	<u>Examination</u>	<u>Reference</u>	<u>Date</u>
FM Approvals (TST1867)	FM 4470	4D6A4.AM	08/09/1999
FM Approvals (TST1867)	FM 4470	1X2A7.AM	08/09/1999
FM Approvals (TST1867)	FM 4470	3005604	03/13/2000
FM Approvals (TST1867)	FM 4470	3008342	10/19/2000
FM Approvals (TST1867)	FM 4470	3009502	12/21/2000
FM Approvals (TST1867)	FM 4470/4474	3012321	07/29/2002
FM Approvals (TST1867)	FM 4470	3015444	07/11/2003
FM Approvals (TST1867)	FM 4470/4474	3014692	08/05/2003
FM Approvals (TST1867)	FM 4470/4474	3023458	07/18/2006
FM Approvals (TST1867)	FM 4470/4474	3026128	08/04/2006
FM Approvals (TST1867)	FM 4470/4474	3026508	05/03/2007
FM Approvals (TST1867)	FM 4470/4474	3030225	06/18/2007
FM Approvals (TST1867)	FM 4470/4474	3033314	08/26/2008
FM Approvals (TST1867)	FM 4470/4474	3032172	06/12/2009
FM Approvals (TST1867)	FM 4470/4474	3041535	06/08/2011
FM Approvals (TST1867)	FM 4470/4474	3040346	07/06/2011
FM Approvals (TST1867)	FM 4470/4474	3040741	10/17/2011
FM Approvals (TST1867)	FM 4470/4474	3047477	10/03/2012
FM Approvals (TST1867)	FM 4470/4474	3044466	11/07/2012
FM Approvals (TST1867)	FM 4470/4474	3056207	02/09/2016
FM Approvals (TST1867)	FM 4470/4474	3054028	05/25/2016
FM Approvals (TST1867)	FM 4470/4474	3055045	05/25/2016
FM Approvals (TST1867)	FM 4470/4474	3058300	07/13/2017
FM Approvals (TST1867)	FM 4470/4474	3059661	09/21/2018
FM Approvals (TST1867)	FM 4470/4474	PR451159	05/09/2019
FM Approvals (TST1867)	FM 4470/4474	PR455277	02/20/2020
NEMO (TST6049)	ASTM D4434, G155	4S-DL-18-001.01.19	01/30/2019
NEMO (TST11294)	FM 4474	2a-DL-19-LSWUS-01.A	06/27/2019
NEMO (TST6049)	ASTM D4434, G154	4r-DL-19-SSTHP-01.A	04/29/2020
NEMO (TST6049)	ASTM D4434, G154	4r-DL-19-SSTHP-01.B	04/29/2020
PRI (TST5878)	FM 4474	DLRI-013-02-01	08/28/2012
PRI (TST5878)	FM 4474	DLRI-014-02-01	08/28/2012
PRI (TST5878)	FM 4474	DLRI-029-02-01	10/25/2012
PRI (TST5878)	FM 4474	DLRI-070-02-01	07/30/2014
PRI (TST5878)	FM 4474	DLRI-073-02-02	11/18/2014
PRI (TST5878)	FM 4474	NGC-034-02-01	03/25/2016
PRI (TST5878)	FM 4474	NGC-035-02-01	05/19/2016
PRI (TST5878)	ASTM D4434	DLRI-080-02-01	08/03/2016
PRI (TST5878)	ASTM D4434, G155	DLRI-123-02-01	03/27/2019
PRI (TST5878)	FM 4474	DLRI-133-02-01	05/09/2019
PRI (TST5878)	FM 4474	DLRI-133-02-02	09/06/2019
PRI (TST5878)	FM 4474	280T0005	04/17/2020
PRI (TST5878)	Small-Scale Criticality	DLRI-021-02-01.16	05/28/2020
UL (TST1740)	UL1897	TGIK.R10128	03/25/2002
UL, LLC. (QUA9625)	Quality Control	Service Confirmation	04/12/2019

4. PRODUCT DESCRIPTION:

This Evaluation Report covers Duro-Last Single Ply Roof Systems installed in accordance with Duro-Last published installation instructions and the Limitations / Conditions of Use herein.

	Product	Material Standard	Plant(s)	Description
4.1	Duro-Last	ASTM D4434 Type III (50, 60, 80-mil) Type IV (40-mil)	Saginaw, MI	Nominal 40-mil (1.0 mm), 50-mil (1.3 mm) or 60-mil (1.5-mm) thick thermoplastic (PVC) roof covering having an 18 x 14 polyester fabric reinforcement composed of 840 x 1000 denier threads.
4.2	Duro-Last EV	ASTM D4434 Type III	Saginaw, MI	Nominal 50-mil (1.3 mm) or 60-mil (1.5-mm) thick thermoplastic (PVC/KEE) roof covering having an 18 x 9 polyester fabric reinforcement with weft insertion, composed of 840 x 1000 denier threads.
4.3	Duro-Tuff	ASTM D4434 Type III	Saginaw, MI	Nominal 50-mil (1.3 mm), 60-mil (1.5-mm) or 80-mil (2.0-mm) thick thermoplastic (PVC) roof covering having an 18 x 9 polyester fabric reinforcement composed of 840 x 1000 denier threads.
4.4	Duro-Fleece	ASTM D4434 Type III	Saginaw, MI	Nominal 50-mil (1.3 mm), 60-mil (1.5-mm) or 80-mil (2.0-mm) thick thermoplastic (PVC) roof covering having an 18 x 9 polyester fabric reinforcement composed of 840 x 1000 denier threads and a polyester fleece backing.
4.5	Duro-Fleece Plus	ASTM D4434 Type III	Hillside, NJ	Nominal 50-mil (1.3 mm) or 60-mil (1.5-mm) thick thermoplastic (PVC) roof covering having an 18 x 14 polyester fabric reinforcement composed of 840 x 1000 denier threads and a polyester fleece backing.

5. LIMITATIONS:

- 5.1 This is a Building Code Evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this Evaluation Report, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.
- 5.2 This Evaluation Report is not for use in FBC High Velocity Hurricane Zone jurisdictions (i.e., Broward and Miami-Dade Counties).
- 5.3 This Evaluation Report pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 5.4 This Evaluation Report does not include evaluation of fire classification. Refer to **FBC 1505** for requirements and limitations regarding roof assembly fire classification. Refer to **FBC 2603** for requirements and limitations concerning the use of foam plastic insulation.
- 5.5 This Evaluation Report does not include evaluation of roof edge termination. Refer to **FBC 1504.5** for requirements and limitations regarding edge securement for low-slope roofs.
- 5.6 Refer to **FBC 1511** for requirements and limitations regarding recover installations.
 - 5.6.1 For mechanically attached components over existing roof decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing shall be in accordance with **ANSI/SPRI FX-1** or **Testing Application Standard TAS 105**.
 - 5.6.2 For bonded insulation or membrane over existing substrates in a re-roof (tear off) or recover installation, the existing deck or existing roof surface shall be examined for compatibility with the adhesive to be installed. If any surface conditions exist that bring system performance into question, field uplift testing in accordance with **ANSI/SPRI IA-1**, **ASTM E907**, **FM Loss Prevention Data Sheet 1-52** or **Testing Application Standard TAS 124** shall be conducted on mock-ups of the proposed new roof assembly.

- 5.6.3 For bonded insulation or membrane over existing substrates in a recover installation, the existing roof system shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing in accordance with **ASTM E907, FM Loss Prevention Data Sheet 1-52 or Testing Application Standard TAS 124.**
- 5.7 Refer to Appendix 1 for system attachment requirements for wind load resistance.
- 5.7.1 “MDP” = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads, and reflects the ultimate passing pressure divided by 2 (the 2 to 1 margin of safety per **FBC 1504.9** has already been applied). Refer to **FBC 1609** for determination of design wind loads.
- 5.7.2 For mechanically attached components or partially-bonded insulation, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with **FBC Chapter 16.** Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are **ANSI/SPRI WD1, FM Loss Prevention Data Sheet 1-29, Roofing Application Standard RAS 117 and Roofing Application Standard RAS 137.** Assemblies marked with an asterisk* carry the limitations set forth in **Section 2.2.10.1 of FM Loss Prevention Data Sheet 1-29 (February 2020)** for Zone 2/3 enhancements.
- 5.7.3 For assemblies with all components fully bonded in place, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with **FBC Chapter 16.** No rational analysis is permitted for these systems.
- 5.8 All components in the roof assembly shall have quality assurance audit in accordance with **F.A.C. Rule 61G20-3.** Refer to the Product Approval of the component manufacturer for components listed in Appendix 1 that are produced by a Product Manufacturer other than the report holder on Page 1 of this Evaluation Report.

6. INSTALLATION:

Duro-Last Single Ply Roof Systems shall be installed in accordance with **Duro-Last Roofing, Inc.** published installation instructions, subject to the Limitations / Conditions of Use noted herein.

7. BUILDING PERMIT REQUIREMENTS:

As required by the Building Official or Authority Having Jurisdiction in order to properly evaluate the installation of this product.

8. MANUFACTURING PLANTS:

Contact the named QA entity for manufacturing facilities covered by **F.A.C. Rule 61G20-3** QA requirements. Refer to Section 4 herein for products and production locations having met codified physical properties specifications.

9. QUALITY ASSURANCE ENTITY:

UL, LLC. – QUA9625; (414) 248-6409; karen.buchmann@us.ul.com

- THE 47-PAGES THAT FOLLOW FORM PART OF THIS EVALUATION REPORT -

APPENDIX 1: ATTACHMENT REQUIREMENTS FOR WIND UPLIFT RESISTANCE

TABLE	DECK	APPLICATION	TYPE	DESCRIPTION	PAGE
1A	Wood	New, Reroof (Tear-Off) or Recover	C-1	Mech. Attached Insulation, Bonded Roof Cover	4
1B	Wood	New, Reroof (Tear-Off) or Recover	C-2	Mechanically Attached Insulation, Plate-Bonded Roof Cover	5-6
1C	Wood	New, Reroof (Tear-Off) or Recover	D-1	Prelim. Attached Insulation, Mechanically Attached Roof Cover	6-7
2A	Steel	New or Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	8
2B	Steel or Structural Concrete	New, Reroof (Tear-Off) or Recover	B	Mechanically Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	9-10
2C	Steel or Structural Concrete	New, Reroof (Tear-Off) or Recover	C-1	Mechanically Attached Insulation, Bonded Roof Cover	10-13
2D	Steel	New, Reroof (Tear-Off) or Recover	C-2	Mechanically Attached Insulation, Plate-Bonded Roof Cover	14-18
2E	Steel	New, Reroof (Tear-Off) or Recover	D-1	Prelim. Attached Insulation, Mechanically Attached Roof Cover	18-20
2F	Steel	New or Reroof (Tear-Off)	D-2	Thermal Barrier, Vapor Barrier, Prelim. Attached Insulation, Mechanically Attached Roof Cover	20
3A	Structural Concrete	New or Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	21-26
3B	Structural Concrete	New, Reroof (Tear-Off) or Recover	C-2	Mechanically Attached Insulation, Plate-Bonded Roof Cover	26-29
3C	Structural Concrete	New, Reroof (Tear-Off) or Recover	D	Prelim. Attached Insulation, Mechanically Attached Roof Cover	30
3D	Structural Concrete	New, Reroof (Tear-Off)	F	Non-Insulated, Bonded Roof Cover	30
4A	Lightweight concrete / steel	New or Reroof (Tear-Off)	A-1	LWIC to Steel Deck, Bonded Insulation, Bonded Roof Cover	31
4B	Lightweight concrete / struct. concrete	New or Reroof (Tear-Off)	A-1	LWIC to Structural Concrete Deck, Bonded Insulation, Bonded Roof Cover	31-33
4C	Lightweight concrete / steel	New or Reroof (Tear-Off)	E-1	LWIC to Steel Deck, Mechanically Attached Roof Cover	34
4D	Lightweight concrete / steel	New or Reroof (Tear-Off)	E-2	LWIC to Steel Deck, Mechanically Attached Base Sheet, Bonded Roof Cover	35
4E	Lightweight concrete / steel	New or Reroof (Tear-Off)	F	LWIC to Steel Deck, Bonded Roof Cover	35
4F	Lightweight concrete / struct. concrete	New or Reroof (Tear-Off)	F	LWIC to Structural Concrete Deck / Bonded Roof Cover	36
5A	Cementitious wood fiber	Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	37
5B	Cementitious wood fiber	New, Reroof (Tear-Off) or Recover	D-1	Prelim. Attached Insulation, Mechanically Attached Roof Cover	37
5C	Cementitious wood fiber	New, Reroof (Tear-Off) or Recover	E-1	Non-insulated, Mechanically Attached Roof Cover	37
6A	Gypsum	Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	38
6B	Gypsum	Reroof (Tear-Off) or Recover	D-1	Prelim. Attached Insulation, Mechanically Attached Roof Cover	39
7A	Various	Recover	A-1	Bonded Insulation, Bonded Roof Cover	39-42
7B	Steel	Recover	C-2	Mechanically Attached Insulation, Plate-Bonded Roof Cover	43-45
7C	Steel	Recover	D-1	Insulated, Mechanically Attached Roof Cover	45-46
7D	Cementitious wood fiber	Recover	E-1	Non-insulated, Mechanically Attached Roof Cover	47
7E	Various	Recover	F	Non-Insulated, Bonded Roof Cover	47

The following notes apply to the systems outlined herein:

- The roof system evaluation herein pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- Unless otherwise noted, fasteners and stress plates for insulation attachment shall be as follows. Fasteners shall be of sufficient length for the following engagements:
 - Wood Deck: Duro-Last #14 HD Fasteners and Duro-Last 3-inch Metal Plates. Min. ¾-inch plywood penetration or minimum 1-inch wood plank embedment.
 - Steel Deck: Duro-Last #14 HD or #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates. Minimum ¾-inch steel penetration, engage the top flute of the steel deck.
 - Structural Concrete: Duro-Last #14 HD Fasteners, Duro-Last Concrete Screws or Duro-Last Fluted Concrete Nails and Duro-Last 3-inch Metal Plates. Minimum 1-inch embedment. Fasteners installed with a pilot hole in accordance with the fastener manufacturer's published installation instructions.
- Unless otherwise noted, insulation may be any one layer or combination of FBC Approved (Local or Statewide) board(s) that meet FBC 1505 and, for foam plastic, FBC Chapter 26, when installed with the roof cover.

4. Minimum 200 psi, minimum 2-inch thick FBC Approved lightweight insulating concrete may be substituted for rigid insulation board for System Type C-2 (plate bonded roof cover) or Type D-1 (mechanically attached roof cover), whereby the membrane fasteners are installed through the lightweight insulating concrete to engage the structural deck. The structural deck shall be of equal or greater type, thickness and strength to the steel and structural concrete deck listings. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction. This is a wind uplift resistance allowance and does not purport to address non-wind-uplift-related issues, such as deck venting or moisture levels within the LWIC and the potential effect on overlying components.
5. Preliminary insulation attachment for System Type D: Unless otherwise noted, refer to Section 2.2.10.1.3 of FM Loss Prevention Data Sheet 1-29 (February 2020).
6. Unless otherwise noted, insulation adhesive application rates are as follows. Ribbon or bead width is at the time of application; the ribbons/beads shall expand as noted in the manufacturer's published instructions.
 - Ashland, Inc. "Pliodeck Insulation Adhesive": Continuous ½ to ¾-inch wide ribbons, 12-inch o.c. Ribbons for subsequent layer(s) shall be run perpendicular to those for the underlying layer.
 - Duro-Grip Board-Max: Continuous 3-inch ribbons, 12-inch o.c.
 - Duro-Grip CR-20: Continuous 2½ to 3½-inch ribbons, 12-inch o.c.
 - Duro-Grip INSTA STIK Quik Set: Continuous ¾ to 1-inch wide ribbons, 12-inch o.c.
 - Duro-Grip OlyBond 500: Continuous ¾ to 1-inch wide ribbons, 12-inch o.c. using PaceCart, SpotShot or Cansiter.
 - Duro-Grip Millennium One Step Adhesive (M-OSA): Continuous 0.25 to 0.5-inch wide ribbons, 12-inch o.c.
 - Hot asphalt: Full mopping, 25-30 lbs/square.
 - OMG "OlyBond Classic": Continuous ¾-inch ribbons, 12-inch o.c. or full-coverage
 - Altenloh, Brinck & Co "Trufast Roofing Adhesive": Continuous ¾ to 1-inch wide ribbons, 12-inch o.c.
 - *Note: When multiple layers(s) of insulation and/or coverboard are installed in ribbon-applied adhesive, boards shall be staggered from layer-to-layer.*
 - *Note: The maximum edge distance from the adhesive ribbon to the edge of the insulation board shall be not less than one-half the specified ribbons spacing.*
7. Unless otherwise noted, all insulations are flat stock or taper board of the minimum thickness noted. Tapered polyisocyanurate at the following thickness limitations may be substituted with the following Maximum Design Pressure (MDP) limitations. In no case shall these values be used to 'increase' the MDP listings in the tables; rather if MDP listing below meets or exceeds that listed for a particular system in the tables, then the thinner board listed below may be used as a drop-in for the equivalent thicker material listed in the table:
 - Duro-Grip CR-20: MDP = -117.5 psf (Min. 1.0-inch thick)
 - Duro-Grip OlyBond 500: MDP = -315.0 psf (Min. 0.5-inch thick H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G)
 - Duro-Grip OlyBond 500: MDP = -487.5 psf (Min. 0.5-inch thick ACFoam II or Duro-Guard ISO II-A)
 - Duro-Grip Millennium One Step Adhesive (M-OSA): MDP = -157.5 psf (Min. 0.5-inch thick)
8. For adhered roof insulation and board-size: Unless otherwise noted, refer to Section 2.2.10.6.2 of FM Loss Prevention Data Sheet 1-29 (February 2020).
9. For mechanically attached components or partially-bonded insulation, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with FBC Chapter 16. Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are ANSI/SPRI WD1, FM Loss Prevention Data Sheet 1-29, Roofing Application Standard RAS 117 and Roofing Application Standard RAS 137. Assemblies marked with an asterisk* carry the limitations set forth in Section 2.2.10.1 of FM Loss Prevention Data Sheet 1-29 (February 2020) for Zone 2/3 enhancements.
10. For assemblies with all components fully bonded, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with FBC Chapter 16. No rational analysis is permitted for these systems.
11. For mechanically attached components over existing decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing shall be in accordance with ANSI/SPRI FX-1 or Testing Application Standard TAS 105.
12. For bonded insulation or membrane over existing substrates in a re-roof (tear off) or recover installation, the existing deck or existing roof surface shall be examined for compatibility with the adhesive to be installed. If any surface conditions exist that bring system performance into question, field uplift testing in accordance shall be conducted on mock-ups of the proposed new roof assembly. For bonded insulation or membrane over existing substrates in a recover installation, the existing roof system shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing. Field uplift testing shall be in accordance with ASTM E907, FM Loss Prevention Data Sheet 1-52 or Testing Application Standard TAS 124.
13. For System Type D, steel deck applications, the roof membrane shall be run with its length perpendicular to the steel deck flutes.

14. Refer to **FBC 1511** for requirements and limitations regarding recover installations. For Structural Concrete Deck or Recover Applications using System Type C-2 (Plate Bonded Roof Cover) or Type D-1 (Mechanically Attached Roof Cover), the insulation is optional. Alternatively, Duro-Blue™, Duro-Weave™, Duro-Last Geotextile Slip Sheet, Duro-Fold™ or Ultra-Fold® TPM or an FBC Approved insulation board or coverboard may be used as a separation layer. Board products shall be preliminarily attached prior to roof cover installation (Note 5 herein). The separator component shall be documented as meeting FBC 1505 and, for foam plastic, FBC Chapter 26, when installed with the roof cover in Recover applications.
15. Lightweight insulating concrete (LWIC) shall be cast in accordance with FBC Section 1917 to the satisfaction of the Authority Having Jurisdiction. For systems where specific LWIC is referenced, refer to current LWIC Product Approval for specific deck construction and limitations. Unless otherwise noted, for systems where specific LWIC is not referenced, the minimum design mix shall be 300 psi. In all cases, the minimum top-coat thickness is 2-inches. For LWIC over structural concrete, reference is made to FBC Section 1917.4.1, Point 1. For “pre-existent” LWIC references, listings were established through testing over lightweight concrete cast using only foaming agent (ASTM C896), water and Portland cement (ASTM C150), with no proprietary additives, in accordance with procedures adopted by Miami-Dade BCCO (FBC CER1592). Use of these listings in new construction or re-roof (tear-off) applications is at the discretion of the Designer or Record and Authority Having Jurisdiction.
16. For adhered membrane systems, side laps shall be minimum 3-inch wide sealed with min. 1.5-inch heat weld. Membrane adhesive application rates are as follows:

MEMBRANE / ADHESIVE COMBINATIONS			
MEMBRANE	ADHESIVE	APPLICATION	RATE
Duro-Last	Duro-Last SB I	Contact	1.5 gal/sq./surface
Duro-Last, Duro-Last EV or Duro-Tuff	Duro-Last SB IV	Contact	1.67 gal/sq./surface
Duro-Last or Duro-Tuff	Duro-Last Solvent-Grip Spray Adhesive	Contact	3.0 lb./sq./surface
Duro-Last	Duro-Last WB I	Contact	0.5 gal/sq./surface
Duro-Last, Duro-Last EV or Duro-Tuff	Duro-Last WB II	Substrate only	0.7 gal/sq.
Duro-Fleece or Duro-Fleece Plus	Duro-Last WB II	Substrate only	1.0 gal/sq.
Duro-Fleece or Duro-Fleece Plus	Duro-Fleece Adhesive	Substrate only	Continuous ¾-inch wide ribbons, 6-inch o.c.
Duro-Fleece or Duro-Fleece Plus	Duro-Fleece CR-20 Membrane Adhesive	Substrate only	Splatter-applied, full coverage per Duro-Last instructions
Duro-Fleece or Duro-Fleece Plus	Altenloh Brinck “Trufast Roofing Adhesive”	Substrate only	RIBBONS: Continuous ¾ to 1-inch wide ribbons, 4-inch o.c., resulting in full-coverage SPLATTER: Splatter-applied, full coverage, 3.0 lbs/square

17. Vapor barrier options for use over **structural concrete deck** followed by adhesive-applied insulation carry the following Maximum Design Pressure (MDP) limitations. The **lesser** of the MDP listings below vs. those in **Table 3A** applies.

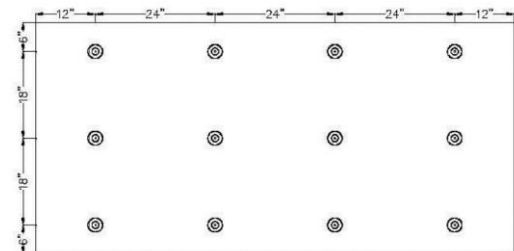
VAPOR BARRIER OPTIONS; STRUCTURAL CONCRETE DECK; FOLLOWED BY ADHESIVE-APPLIED INSULATION PER TABLE 3A:					
Option #	Primer	Vapor Barrier		Insulation Adhesive	MDP (psf)
		Type	Application		
VB-1.	ASTM D41	Duro-Last Torch Down Vapor Barrier	torch-applied	Board-Max, 12-inch o.c.	-37.5
VB-2.	ASTM D41	Duro-Last Torch Down Vapor Barrier	torch-applied	OlyBond 500, 12-inch o.c.	-382.5
VB-3.	ASTM D41	Duro-Last Torch Down Vapor Barrier	torch-applied	Trufast Roofing Adhesive, 12-inch o.c.	-180.0
VB-4.	ASTM D41	Duro-Last Torch Down Vapor Barrier	torch-applied	Millennium One Step Adhesive, 12-inch o.c.	-270.0
VB-5.	Duro-Last VB Primer	Duro-Last Vapor Barrier	self-adhering	Board-Max, 12-inch o.c.	-37.5
VB-6.	Duro-Last VB Primer	Duro-Last Vapor Barrier	self-adhering	OlyBond 500, 12-inch o.c.	-187.5
VB-7.	Duro-Last VB Primer	Duro-Last Vapor Barrier	self-adhering	Trufast Roofing Adhesive, 12-inch o.c.	-390.0
VB-8.	Duro-Last VB Primer	Duro-Last Vapor Barrier	self-adhering	Millennium One Step Adhesive, 12-inch o.c.	-172.5

18. “MDP” = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads. Refer to FBC 1609 for determination of design wind pressures.

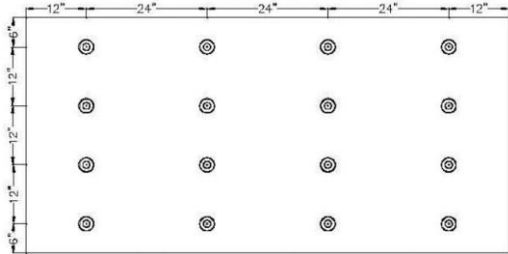
**TABLE 1A: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer	Top Insulation Layer			Roof Cover (Note 16)	MDP (psf)
			Type	Fasteners	Attach		
BAREBACK MEMBRANE APPLICATIONS:							
W-1.	Min. 19/32-inch APA rated plywood	(Optional) One or more layers, any combination	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates	1 per 2.0 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-52.5
W-2.	Min. 19/32-inch APA rated plywood	(Optional) One or more layers, any combination	Min. 7/16-inch DEXcell Cement Roof Board	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates	1 per 2.0 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV	-52.5
W-3.	Min. 19/32-inch APA rated plywood	(Optional) One or more layers, any combination	Min. 7/16-inch DEXcell Cement Roof Board	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates	1 per 2.0 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / WB II	-60.0
W-4.	Min. 19/32-inch APA rated plywood	(Optional) One or more layers, any combination	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates	1 per 1.8 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-67.5
W-5.	Min. 19/32-inch APA rated plywood	(Optional) One or more layers, any combination	Min. 7/16-inch DEXcell Cement Roof Board	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates	1 per 1.8 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV	-67.5
W-6.	Min. 19/32-inch APA rated plywood	(Optional) One or more layers, any combination	Min. 7/16-inch DEXcell Cement Roof Board	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates	1 per 1.8 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / WB II	-75.0
DURO-FLEECE OR DURO-FLEECE PLUS MEMBRANE APPLICATIONS:							
W-7.	Min. 19/32-inch APA rated plywood	(Optional) One or more layers, any combination	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates	1 per 2.0 ft ²	Duro-Fleece or Duro-Fleece Plus / Trufast Roofing Adhesive (SPLATTER) or WB II	-52.5
W-8.	Min. 19/32-inch APA rated plywood	(Optional) One or more layers, any combination	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates	1 per 2.0 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied)	-60.0
W-9.	Min. 19/32-inch APA rated plywood	(Optional) One or more layers, any combination	Min. 7/16-inch DEXcell Cement Roof Board	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates	1 per 2.0 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied), Trufast Roofing Adhesive (SPLATTER) or WB II	-60.0
W-10.	Min. 19/32-inch APA rated plywood	(Optional) One or more layers, any combination	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates	1 per 1.8 ft ²	Duro-Fleece or Duro-Fleece Plus / Trufast Roofing Adhesive (SPLATTER) or WB II	-67.5
W-11.	Min. 19/32-inch APA rated plywood	(Optional) One or more layers, any combination	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates	1 per 1.8 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied)	-75.0
W-12.	Min. 19/32-inch APA rated plywood	(Optional) One or more layers, any combination	Min. 7/16-inch DEXcell Cement Roof Board	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 3-inch Metal Plates	1 per 1.8 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied), Trufast Roofing Adhesive (splatter applied) or WB II	-75.0

**TABLE 1B: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: MECHANICALLY ATTACHED INSULATION, PLATE-BONDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 14)	Attach		Roof Cover / Attach	MDP (psf)	
			Fasteners	Density			
RHINO BOND INDUCTION WELD:							
W-13.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) One or more layers, any combination; preliminarily attached	Duro-Last #14 HD with RHINO BOND Insulation Plate (PVC)	Fasteners 12-inch o.c. in rows spaced 72-inch o.c. positioned atop wood trusses; minimum 0.9-inch fastener embedment into trusses	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-37.5	
W-14.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) One or more layers, any combination; preliminarily attached	Duro-Last #14 HD with RHINO BOND Insulation Plate (PVC)	Fasteners 18-inch o.c. in rows spaced 48-inch o.c. positioned atop wood trusses; minimum 0.9-inch fastener embedment into trusses	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-37.5	
W-15.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) One or more layers, any combination; preliminarily attached	Duro-Last #14 HD with RHINO BOND Insulation Plate (PVC)	Fasteners 12-inch o.c. in rows spaced 48-inch o.c. positioned atop wood trusses; minimum 0.9-inch fastener embedment into trusses	Duro-Last (min. 60 mil) , Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-52.5	
W-16.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) One or more layers, any combination; preliminarily attached	Duro-Last #14 HD with RHINO BOND Insulation Plate (PVC)	Fasteners 6-inch o.c. in rows spaced 96-inch o.c. positioned atop wood trusses; minimum 0.9-inch fastener embedment into trusses	Duro-Last (min. 60 mil) , Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-60.0	
W-17.	Min. 19/32-inch plywood at max. 24-inch spans	One or more layers, any combination; min. 1.5-inch, min. 16 psi	Duro-Last #14 HD with RHINO BOND Insulation Plate (PVC)	1 per 2.7 ft ² (12 parts per 4 x 8 ft bird; Fasteners engage wood trusses, minimum 0.9-inch embedment)		Duro-Last (min. 40 mil), Duro-Tuff (min. 50 mil) or Duro-Last EV (min. 50-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-60.0

**TABLE 1B: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: MECHANICALLY ATTACHED INSULATION, PLATE-BONDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 14)	Attach		Roof Cover / Attach	MDP (psf)	
			Fasteners	Density			
W-18.	Min. 19/32-inch plywood at max. 24-inch spans	One or more layers, any combination; min. 1.5-inch, min. 16 psi	Duro-Last #14 HD with RHINO BOND Insulation Plate (PVC)	1 per 2.0 ft ² (16 parts per 4 x 8 ft board; Fasteners engage wood trusses, minimum 0.9-inch embedment)		Duro-Last (min. 40 mil), Duro-Tuff (min. 50 mil) or Duro-Last EV (min. 50-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-90.0

**TABLE 1C: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: PRELIMINARILY ATTACHED INSULATION, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck (Note 1)	Insulation (Note 14)		Roof Cover			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners	Attach	
STANDARD LAP SYSTEMS:							
W-19.	Min. 19/32-inch APA rated CDX plywood at max. 32-inch spans	0.5-inch Duro-Guard EPS Fan Fold and/or min. 1-inch Duro-Guard ISO II-H, Duro-Guard ISO II-G, Duro-Guard ISO II-A, Duro-Guard ISO III-H or Duro-Guard ISO III-A	Prelim. attached	Duro-Last, min. 40-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last Poly-Plates or Duro-Last Cleat Plates	<u>Standard Lap System</u> fastened 12-inch o.c. within 6-inch wide tabs spaced 58-inch o.c.	-30.0
W-20.	Min. 19/32-inch APA rated CDX plywood at max. 32-inch spans	0.5-inch Duro-Guard EPS Fan Fold and/or min. 1-inch Duro-Guard ISO II-H, Duro-Guard ISO II-G, Duro-Guard ISO II-A, Duro-Guard ISO III-H or Duro-Guard ISO III-A	Prelim. attached	Duro-Last EV, min. 50-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last Poly-Plates or Duro-Last Cleat Plates	<u>Standard Lap System</u> fastened 12-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Lap sealed with 1.5-inch heat weld	-30.0
W-21.	Min. 19/32-inch APA rated CDX plywood at max. 32-inch spans	0.5-inch Duro-Guard EPS Fan Fold and/or min. 1-inch Duro-Guard ISO II-H, Duro-Guard ISO II-G, Duro-Guard ISO II-A, Duro-Guard ISO III-H or Duro-Guard ISO III-A	Prelim. attached	Duro-Tuff, min. 50-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners Duro-Last Cleat Plates	<u>Standard Lap System</u> fastened 12-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Lap sealed with 1.5-inch heat weld	-30.0
W-22.	Min. 19/32-inch APA rated CDX plywood at max. 32-inch spans	0.5-inch Duro-Guard EPS Fan Fold and/or min. 1-inch Duro-Guard ISO II-H, Duro-Guard ISO II-G, Duro-Guard ISO II-A, Duro-Guard ISO III-H or Duro-Guard ISO III-A	Prelim. attached	Duro-Last EV, min. 50-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last Poly-Plates or Duro-Last Cleat Plates	<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide laps spaced 114-inch o.c. Lap sealed with 1.5-inch heat weld	-37.5
W-23.	Min. 19/32-inch APA rated CDX plywood at max. 32-inch spans	0.5-inch Duro-Guard EPS Fan Fold and/or min. 1-inch Duro-Guard ISO II-H, Duro-Guard ISO II-G, Duro-Guard ISO II-A, Duro-Guard ISO III-H or Duro-Guard ISO III-A	Prelim. attached	Duro-Tuff, min. 50-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last Cleat Plates	<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide laps spaced 114-inch o.c. Lap sealed with 1.5-inch heat weld	-37.5

**TABLE 1C: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: PRELIMINARILY ATTACHED INSULATION, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck (Note 1)	Insulation (Note 14)		Roof Cover			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners	Attach	
W-24.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) One or more layers, any combination	Prelim. attached	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last 2.4-inch Barbed Metal Plate	<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide tabs spaced 57-inch o.c. <i>Screws located 2.7-inches from tab edge</i>	-52.5
W-25.	Min. 19/32-inch APA rated CDX plywood at max. 32-inch spans	0.5-inch Duro-Guard EPS Fan Fold and/or min. 1-inch Duro-Guard ISO II-H, Duro-Guard ISO II-G, Duro-Guard ISO II-A, Duro-Guard ISO III-H or Duro-Guard ISO III-A	Prelim. attached	Duro-Last, min. 40-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last Poly-Plates or Duro-Last Cleat Plates	<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide tabs spaced 58-inch o.c.	-52.5
W-26.	Min. 19/32-inch APA rated CDX plywood at max. 32-inch spans	0.5-inch Duro-Guard EPS Fan Fold and/or min. 1-inch Duro-Guard ISO II-H, Duro-Guard ISO II-G, Duro-Guard ISO II-A, Duro-Guard ISO III-H or Duro-Guard ISO III-A	Prelim. attached	Duro-Last EV, min. 50-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last Poly-Plates or Duro-Last Cleat Plates	<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Lap sealed with 1.5-inch heat weld	-52.5
W-27.	Min. 19/32-inch APA rated CDX plywood at max. 32-inch spans	0.5-inch Duro-Guard EPS Fan Fold and/or min. 1-inch Duro-Guard ISO II-H, Duro-Guard ISO II-G, Duro-Guard ISO II-A, Duro-Guard ISO III-H or Duro-Guard ISO III-A	Prelim. attached	Duro-Tuff, min. 50-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners and Duro-Last Cleat Plates	<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Lap sealed with 1.5-inch heat weld	-52.5
DURO-ROOF LAP SYSTEMS:							
W-28.	Min. 19/32-inch plywood at max. 24-inch spans	(Optional) One or more layers, any combination	Prelim. attached	Duro-Last, min. 40 mil	Duro-Last #14 HD Fasteners with Duro-Last 3-inch Metal Plates	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 6-inch wide tabs spaced 57-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-52.5
W-29.	Nominal 1 x 6 –inch T&G board decking attached per FBC Section 2322.2.2	One or more layers, any combination, min. 1.5-inch	Prelim. Attached	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with OMG 2-3/8" Eyehook Plates	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 6-inch wide tabs spaced 25-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-97.5

**TABLE 2A: STEEL DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
BAREBACK MEMBRANE APPLICATIONS:							
S-1.	22 ga., Type B, Grade 60 steel	Min. 1.5-inch Duro-Guard ISO II-H	M-OSA, 12-inch o.c. (every-other deck flange)	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	M-OSA	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV	-75.0
S-2.	22 ga., Type B, Grade 60 steel	Min. 1.5-inch Duro-Guard ISO II-H	M-OSA, 12-inch o.c. (every-other deck flange)	(Optional) Additional layer(s) base insulation	M-OSA	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV	-82.5
S-3.	22 ga., Type B, Grade 60 steel	Min. 1.5-inch Duro-Guard ISO II-H	M-OSA, 12-inch o.c. (every-other deck flange)	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	M-OSA	Duro-Last, Duro-Last EV or Duro-Tuff / WB II	-75.0
S-4.	22 ga., Type B, Grade 60 steel	Min. 1.5-inch Duro-Guard ISO II-H	M-OSA, 12-inch o.c. (every-other deck flange)	(Optional) Additional layer(s) base insulation	M-OSA	Duro-Last, Duro-Last EV or Duro-Tuff / WB II	-82.5
DURO-FLEECE OR DURO-FLEECE PLUS MEMBRANE APPLICATIONS:							
S-5.	22 ga., Type B, Grade 60 steel	Min. 1.5-inch Duro-Guard ISO II-H	M-OSA, 12-inch o.c. (every-other deck flange)	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	M-OSA	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied), Trufast Roofing Adhesive (SPLATTER) or WB II	-75.0
S-6.	22 ga., Type B, Grade 60 steel	Min. 1.5-inch Duro-Guard ISO II-H	M-OSA, 12-inch o.c. (every-other deck flange)	(Optional) Additional layer(s) base insulation	M-OSA	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied) or WB II	-82.5

**TABLE 2B: STEEL OR STRUCTURAL CONCRETE - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Fasteners	Attach	Type	Attach (Note 6,7&8)		
BAREBACK MEMBRANE APPLICATIONS:								
S-7.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	Min. 2-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Note 2	1 per 4.0 ft ²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Hot asphalt or Board-Max, CR-20, INSTA STIK Quik Set or Trufast Roofing Adhesive	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-37.5*
S-8.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	Min. 2-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Note 2	1 per 4.0 ft ²	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	Hot asphalt, INSTA STIK Quik Set, OB500 or M-OSA	Duro-Last / SB IV	-37.5*
S-9.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	Min. 2-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Note 2	1 per 4.0 ft ²	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	Hot asphalt, INSTA STIK Quik Set, OB500 or M-OSA	Duro-Last or Duro-Tuff / WB II	-37.5*
S-10.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	Min. 2-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Note 2	1 per 2.7 ft ²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Hot asphalt or Board-Max, CR-20, INSTA STIK Quik Set or Trufast Roofing Adhesive	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0*
S-11.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	Min. 2-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Note 2	1 per 2.7 ft ²	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	Hot asphalt, INSTA STIK Quik Set, OB500 or M-OSA	Duro-Last / SB IV	-45.0*
S-12.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	Min. 2-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Note 2	1 per 2.7 ft ²	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	Hot asphalt, INSTA STIK Quik Set, OB500 or M-OSA	Duro-Last or Duro-Tuff / WB II	-45.0*
S-13.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	Min. 2-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Note 2	1 per 1.3 ft ²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Hot asphalt or Board-Max, CR-20, INSTA STIK Quik Set or Trufast Roofing Adhesive, 6-inch o.c.	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-60.0
DURO-FLEECE OR DURO-FLEECE PLUS MEMBRANE APPLICATIONS:								
S-14.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	Min. 2-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Note 2	1 per 4.0 ft ²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Hot asphalt or Board-Max, CR-20, INSTA STIK Quik Set or Trufast Roofing Adhesive, 6-inch o.c.	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied), Trufast Roofing Adhesive (SPLATTER) or WB II	-37.5*
S-15.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	Min. 2-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Note 2	1 per 4.0 ft ²	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	Hot asphalt, INSTA STIK Quik Set, OB500 or M-OSA	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-37.5*

TABLE 2B: STEEL OR STRUCTURAL CONCRETE - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Fasteners	Attach	Type	Attach (Note 6,7&8)		
S-16.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	Min. 2-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Note 2	1 per 2.7 ft ²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Hot asphalt or Board-Max, CR-20, INSTA STIK Quik Set or Trufast Roofing Adhesive, 6-inch o.c.	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied), Trufast Roofing Adhesive (SPLATTER) or WB II	-45.0*
S-17.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	Min. 2-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Note 2		Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	Hot asphalt, INSTA STIK Quik Set, OB500 or M-OSA	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-45.0*
S-18.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	Min. 2-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Note 2	1 per 1.3 ft ²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Hot asphalt or Board-Max, CR-20, INSTA STIK Quik Set or Trufast Roofing Adhesive, 6-inch o.c.	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied) or WB II	-60.0

TABLE 2C: STEEL OR STRUCTURAL CONCRETE - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer	Top Insulation Layer			Roof Cover (Note 16)	MDP (psf)
			Type	Fasteners	Attach		
DURO-LAST MEMBRANE APPLICATIONS:							
S-19.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch DensDeck or DensDeck Prime	Note 2	1 per 2.7 ft ²	Duro-Last / SB I or WB II	-30.0*
S-20.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch DensDeck Prime	Note 2	1 per 2.7 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-30.0*
S-21.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. ½-inch DensDeck or DensDeck Prime	Note 2	1 per 3.2 ft ²	Duro-Last / SB I or WB II	-30.0*
S-22.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. ½-inch DensDeck or DensDeck Prime	Note 2	1 per 3.2 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-30.0*
S-23.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 5/8-inch DensDeck or DensDeck Prime	Note 2	1 per 4.0 ft ²	Duro-Last / SB I or WB II	-30.0*
S-24.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 5/8-inch DensDeck or DensDeck Prime	Note 2	1 per 4.0 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-30.0*
S-25.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Note 2	1 per 2.7 ft ²	Duro-Last or Duro-Tuff / Solvent-Grip Spray Adhesive	-37.5*
S-26.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 1.0-inch ACFoam II, Duro-Guard ISO II-A or ACFoam Recover	Note 2	1 per 2.0 ft ²	Duro-Last / WB II	-37.5*
S-27.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 1.0-inch ACFoam II, Duro-Guard ISO II-A	Note 2	1 per 2.0 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-37.5*

**TABLE 2C: STEEL OR STRUCTURAL CONCRETE - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer	Top Insulation Layer			Roof Cover (Note 16)	MDP (psf)
			Type	Fasteners	Attach		
S-28.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.7 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-37.5*
S-29.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 1.5-inch H-Shield, Duro-Guard ISO II-H	Note 2	1 per 2.7 ft ²	Duro-Last or Duro-Tuff / Solvent-Grip Spray Adhesive	-45.0*
S-30.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Note 2	1 per 2.0 ft ²	Duro-Last / WB I	-45.0*
S-31.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Note 2	1 per 2.0 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV	-45.0*
S-32.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 2-inch ACFoam II, Duro-Guard ISO II-A or ACFoam III, Duro-Guard ISO III-A	Note 2	1 per 4.0 ft ²	Duro-Last / SB I	-45.0*
S-33.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 2-inch ACFoam III, Duro-Guard ISO III-A	Note 2	1 per 4.0 ft ²	Duro-Last / WB I	-45.0*
S-34.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	One or more layers, any combination, min. 1.5-inch thick	Min. 0.25-inch Invinsa Roof Board	Note 2	1 per 2.0 ft ²	Duro-Last / SB IV	-45.0*
S-35.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch DensDeck or DensDeck Prime	Note 2	1 per 2.0 ft ²	Duro-Last / SB I or WB II	-45.0*
S-36.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch DensDeck or DensDeck Prime	Note 2	1 per 2.0 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0*
S-37.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.625-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	Note 2	1 per 5.3 ft ²	Duro-Last / SB IV	-45.0*
S-38.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.625-inch DEXcell FA Glass Mat Roof Board	Note 2	1 per 5.3 ft ²	Duro-Last or Duro-Tuff / WB II	-45.0*
S-39.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.5-inch DEXcell FA Glass Mat Roof Board	Note 2	1 per 4.0 ft ²	Duro-Last / SB IV	-45.0*
S-40.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.5-inch DEXcell FA Glass Mat Roof Board	Note 2	1 per 4.0 ft ²	Duro-Last or Duro-Tuff / WB II	-45.0*
S-41.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Note 2	1 per 3.2 ft ²	Duro-Last / SB IV	-45.0*
S-42.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Note 2	1 per 3.2 ft ²	Duro-Last or Duro-Tuff / WB II	-45.0*
S-43.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0*
S-44.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 5/8-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0*

**TABLE 2C: STEEL OR STRUCTURAL CONCRETE - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer	Top Insulation Layer			Roof Cover (Note 16)	MDP (psf)
			Type	Fasteners	Attach		
S-45.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 2-inch ACFoam II, Duro-Guard ISO II-A	Dekfast #15 with Dekfast Hex	1 per 2.0 ft ²	Duro-Last / SB I	-60.0
S-46.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	One or more layers, any combination, min. 1.5-inch thick	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.3 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-67.5
S-47.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	One or more layers, any combination, min. 1.5-inch thick	Min. 0.25-inch DensDeck Prime	Note 2 (#15 Extra Heavy Duty only)	1 per 1.7 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV	-67.5
S-48.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch DensDeck	Dekfast #15 with Dekfast Hex	1 per 2.0 ft ²	Duro-Last / SB I or WB II	-75.0
S-49.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 15/32-inch APA Rated, Grade B-C plywood	OMG XHD with OMG Flat Bottom Plates (3-inch square metal)	1 per 2.0 ft ²	Duro-Last / SB I or WB II	-90.0
S-50.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch total thickness	Min. 0.5-inch SECUROCK Gypsum Fiber Roof Board	Trufast #12 DP with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-97.5
DURO-FLEECE OR DURO-FLEECE PLUS MEMBRANE APPLICATIONS:							
S-51.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch DensDeck Prime	Note 2	1 per 2.7 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-30.0*
S-52.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. ½-inch DensDeck or DensDeck Prime	Note 2	1 per 3.2 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-30.0*
S-53.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 5/8-inch DensDeck or DensDeck Prime	Note 2	1 per 4.0 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-30.0*
S-54.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.7 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-37.5*
S-55.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 1.0-inch ACFoam II, Duro-Guard ISO II-A	Note 2	1 per 2.0 ft ²	Duro-Fleece or Duro-Fleece Plus / WB II	-37.5*
S-56.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, ACFoam III, Duro-Guard ISO III-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3, Duro-Guard ISO II-G or ISO 95+ GL	Note 2	1 per 2.0 ft ²	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0*

**TABLE 2C: STEEL OR STRUCTURAL CONCRETE - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation Layer	Top Insulation Layer			Roof Cover (Note 16)	MDP (psf)
			Type	Fasteners	Attach		
S-57.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.625-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	Note 2	1 per 5.3 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-45.0*
S-58.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.5-inch DEXcell FA Glass Mat Roof Board	Note 2	1 per 4.0 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-45.0*
S-59.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Note 2	1 per 3.2 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-45.0*
S-60.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-45.0*
S-61.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 5/8-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-45.0*
S-62.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.5-inch DensDeck	Note 2	1 per 2.0 ft ²	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0*
S-63.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, ACFoam III or ISO 95+ GL	Note 2	1 per 2.0 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece Adhesive	-45.0*
S-64.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination	Min. 0.5-inch DensDeck	Note 2	1 per 2.0 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece Adhesive	-45.0*
S-65.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	One or more layers, any combination, min. 1.5-inch thick	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.3 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-67.5
S-66.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	One or more layers, any combination, min. 1.5-inch thick	Min. 0.25-inch DensDeck Prime	Note 2 (#15 Extra Heavy Duty only)	1 per 1.7 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER)	-67.5
S-67.	Min. 22 ga., Type B, Grade 33 steel or structural concrete	(Optional) One or more layers, any combination, min. 1.5-inch thick	Min. 0.25-inch DensDeck Prime	Note 2	1 per 1.3 ft ²	Duro-Fleece or Duro-Fleece Plus / WB II	-67.5
S-68.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch total thickness	Min. 0.5-inch SECUROCK Gypsum Fiber Roof Board	Trufast #12 DP with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-97.5

**TABLE 2D: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: MECHANICALLY ATTACHED INSULATION, PLATE-BONDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 14)	Attach		Roof Cover / Attach	MDP (psf)
			Fasteners	Density		
RHINO BOND INDUCTION WELD:						
S-69.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with RHINO BOND Insulation Plate (PVC)	1 per 4.0 ft ² (2 x 2-ft grid)	Duro-Last (min. 40-mil), Duro-Tuff (min. 50-mil) or Duro-Last EV (min. 50-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-37.5
S-70.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with RHINO BOND Insulation Plate (PVC)	1 per 6 ft ² (24 x 36 inch grid pattern)	Duro-Last (min. 40-mil), Duro-Tuff (min. 50-mil) or Duro-Last EV (min. 50-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-45.0*
S-71.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with RHINO BOND Insulation Plate (PVC)	1 per 2.29 ft ² (14 parts per 4 x 8 ft board in 18 x 18 inch grid pattern)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-45.0
S-72.	Min. 20 ga., Type N, Grade 40 steel	One or more layers DURO-GUARD ISO II-A, DURO-GUARD ISO II-G, DURO-GUARD ISO II-H, DURO-GUARD ISO III-A or DURO-GUARD ISO III-H; top layer min. 1-inch	OMG XHD with RHINO BOND Insulation Plate (PVC)	1 per 4.0 ft ² (8 parts per 4 x 8 ft board) <i>Parts spaced 24" o.c. in rows spaced 24" o.c., while maintaining fastener engagement with the top flange of the Type N deck profile. Every-other set of two (2) rows is staggered 8-inches from the previous set.</i>	Duro-Last (min. 40-mil), Duro-Tuff (min. 50-mil) or Duro-Last EV (min. 50-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-52.5
S-73.	Min. 18 ga., type B, Grade 33 steel	One or more layers, any combination, preliminarily attached (Note 5)	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with RHINO BOND Insulation Plate (PVC)	12-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-30.0
S-74.	Min. 18 ga., type B, Grade 33 steel	One or more layers, any combination, preliminarily attached (Note 5)	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with RHINO BOND Insulation Plate (PVC)	6-inch o.c. in rows spaced 120-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-45.0
S-75.	Min. 18 ga., type B, Grade 33 steel	One or more layers, any combination, preliminarily attached (Note 5)	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with RHINO BOND Insulation Plate (PVC)	12-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-45.0
S-76.	Min. 18 ga., type B, Grade 33 steel	One or more layers, any combination, preliminarily attached (Note 5)	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with RHINO BOND Insulation Plate (PVC)	6-inch o.c. in rows spaced 72-inch o.c.	Duro-Last (min. 40-mil), Duro-Tuff (min. 50-mil) or Duro-Last EV (min. 50-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-52.5
S-77.	Min. 18 ga., type B, Grade 33 steel	One or more layers, any combination, preliminarily attached (Note 5)	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with RHINO BOND Insulation Plate (PVC)	6-inch o.c. in rows spaced 96-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-52.5
S-78.	Min. 18 ga., type B, Grade 33 steel	One or more layers, any combination, preliminarily attached (Note 5)	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with RHINO BOND Insulation Plate (PVC)	6-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 40-mil), Duro-Tuff (min. 50-mil) or Duro-Last EV (min. 50-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-82.5
S-79.	Min. 18 ga., type B, Grade 33 steel	One or more layers, any combination, preliminarily attached (Note 5)	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with RHINO BOND Insulation Plate (PVC)	6-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-82.5

**TABLE 2D: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: MECHANICALLY ATTACHED INSULATION, PLATE-BONDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 14)	Attach		Roof Cover / Attach	MDP (psf)
			Fasteners	Density		
S-80.	Min. 18 ga., type B, Grade 33 steel	One or more layers, any combination, preliminarily attached (Note 5)	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with RHINO BOND Insulation Plate (PVC)	6-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-90.0
ISOWELD INDUCTION WELD:						
S-81.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	SFS Intec Dekfast DF-#15-PH3 with <i>isoweld</i> ® F1-P-6.8-PVC Plates	6 ft² per fastener 2 x 3-ft grid, staggered	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-37.5
S-82.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	SFS Intec Dekfast DF-#12-PH3 or DF-#15-PH3 Fastener with <i>isoweld</i> ® F1-P-6.8-PVC Plates	6 ft² per fastener 2 x 3-ft grid, staggered	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-37.5
S-83.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	SFS Intec Dekfast DF-#15-PH3 with <i>isoweld</i> ® F1-P-6.8-PVC Plates	4 ft² per fastener 2 x 2-ft grid, staggered	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-52.5
S-84.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	SFS Intec Dekfast DF-#12-PH3 or DF-#15-PH3 Fastener with <i>isoweld</i> ® F1-P-6.8-PVC Plates	4 ft² per fastener 2 x 2-ft grid, staggered	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-52.5
S-85.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	SFS Intec Dekfast DF-#15-PH3 with <i>isoweld</i> ® F1-P-6.8-PVC Plates	3 ft² per fastener 1.5 x 2-ft grid, staggered	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-82.5
S-86.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	SFS Intec Dekfast DF-#12-PH3 or DF-#15-PH3 Fastener with <i>isoweld</i> ® F1-P-6.8-PVC Plates	3 ft² per fastener 1.5 x 2-ft grid, staggered	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-82.5
S-87.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch, preliminarily attached (Note 5)	SFS Intec Dekfast DF-#15-PH3 with <i>isoweld</i> ® F1-P-6.8-PVC Plates	12-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-45.0
S-88.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch, preliminarily attached (Note 5)	SFS Intec Dekfast DF-#12-PH3 or DF-#15-PH3 Fastener with <i>isoweld</i> ® F1-P-6.8-PVC Plates	12-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-45.0
S-89.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch, preliminarily attached (Note 5)	SFS Intec Dekfast DF-#15-PH3 with <i>isoweld</i> ® F1-P-6.8-PVC Plates	6-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-90.0
S-90.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch, preliminarily attached (Note 5)	SFS Intec Dekfast DF-#12-PH3 or DF-#15-PH3 Fastener with <i>isoweld</i> ® F1-P-6.8-PVC Plates	6-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-90.0
TRUFAST INDUCTION WELD:						

**TABLE 2D: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: MECHANICALLY ATTACHED INSULATION, PLATE-BONDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 14)	Attach		Roof Cover / Attach	MDP (psf)
			Fasteners	Density		
S-91.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 5.3 ft ² (6 parts per 4x8 ft board on a 24x36-inch pattern)	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-45.0*
S-92.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 4.0 ft ² (8 parts per 4x8 ft board on a 24x24-inch pattern)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-52.5
S-93.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 4.0 ft ² (8 parts per 4x8 ft board on a 24x24-inch pattern)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-60.0
S-94.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 3.2 ft ² (10 parts per 4x8 ft board on a 24x20-inch pattern)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-60.0
S-95.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 3.2 ft ² (10 parts per 4x8 ft board on a 24x20-inch pattern)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-67.5
S-96.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 2.7 ft ² (12 parts per 4x8 ft board per FM LPDS 1-29)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-67.5
S-97.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 2.7 ft ² (12 parts per 4x8 ft board per FM LPDS 1-29)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-82.5
S-98.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 2.0 ft ² (16 parts per 4x8 ft board on a 12x24-inch pattern)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-90.0
S-99.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 2.0 ft ² (16 parts per 4x8 ft board on a 12x24-inch pattern)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-112.5
S-100.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 1.8 ft ² (18 parts per 4x8 ft board on an 18x16-inch pattern)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-105.0
S-101.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 1.8 ft ² (18 parts per 4x8 ft board on an 18x16-inch pattern)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-120.0
S-102.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 1.3 ft ² (24 parts per 4x8 ft board on a 12x16-inch pattern)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-135.0

**TABLE 2D: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: MECHANICALLY ATTACHED INSULATION, PLATE-BONDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 14)	Attach		Roof Cover / Attach	MDP (psf)
			Fasteners	Density		
S-103.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 1.3 ft ² (24 parts per 4x8 ft board on a 12x16-inch pattern)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-172.5
S-104.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 1.0 ft ² (32 parts per 4x8 ft board per FM LPDS 1-29)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-142.5
S-105.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	1 per 1.0 ft ² (32 parts per 4x8 ft board per FM LPDS 1-29)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-217.5
S-106.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #15 EHD with Trufast PVC IW Plate	12-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-45.0
S-107.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #15 EHD with Trufast PVC IW Plate	12-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-52.5
S-108.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #15 EHD with Trufast PVC IW Plate	12-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-60.0
S-109.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	12-inch o.c. in rows spaced 36-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-60.0
S-110.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	12-inch o.c. in rows spaced 36-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-82.5
S-111.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #15 EHD with Trufast PVC IW Plate	6-inch o.c. in rows spaced 72-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-67.5
S-112.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #15 EHD with Trufast PVC IW Plate	6-inch o.c. in rows spaced 72-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-75.0
S-113.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #15 EHD with Trufast PVC IW Plate	6-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-75.0
S-114.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #15 EHD with Trufast PVC IW Plate	6-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-90.0

**TABLE 2D: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: MECHANICALLY ATTACHED INSULATION, PLATE-BONDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 14)	Attach		Roof Cover / Attach	MDP (psf)
			Fasteners	Density		
S-115.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #15 EHD with Trufast PVC IW Plate	6-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-90.0
S-116.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #15 EHD with Trufast PVC IW Plate	6-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-112.5
S-117.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	6-inch o.c. in rows spaced 36-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-112.5
S-118.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch	Trufast #15 EHD with Trufast PVC IW Plate	6-inch o.c. in rows spaced 36-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-150.0

**TABLE 2E: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: PRELIMINARILY ATTACHED INSULATION, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck (Note 1)	Insulation (Note 14)		Roof Cover			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners	Attach	
STANDARD LAP SYSTEMS:							
S-119.	Min. 22 ga., Type B, 50 ksi steel	One or more layers, any combination, min. 1-inch	Prelim. attach	Duro-Last EV, min. 50-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Poly-Plate	<u>Standard Lap System</u> fastened 18-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Laps sealed with 1.5-inch heat weld.	-30.0
S-120.	Min. 22 ga., Type B, 50 ksi steel	One or more layers, any combination, min. 1-inch	Prelim. attach	Duro-Last EV, min. 50-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Cleat Plate	<u>Standard Lap System</u> fastened 12-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Laps sealed with 1.5-inch heat weld.	-37.5
S-121.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Cleat Plate	<u>Standard Lap System</u> fastened 12-inch o.c. within 5.75-inch wide tabs spaced 120-inch o.c.	-37.5
S-122.	Min. 18 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Poly-Plate	<u>Standard Lap System</u> fastened 9-inch o.c. within 3-inch wide tabs spaced 60-inch o.c.	-45.0
S-123.	Min. 22 ga., Type B, 50 ksi steel	One or more layers, any combination, min. 1-inch	Prelim. attach	Duro-Last EV, min. 50-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Poly-Plate	<u>Standard Lap System</u> fastened 12-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Laps sealed with 1.5-inch heat weld.	-45.0
S-124.	Min. 22 ga., Type B, Grade 40 steel	One or more layers, any combination, min. 1-inch	Prelim. attach	Duro-Last EV, min. 50-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Poly-Plate	<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide laps spaced 114-inch o.c. Laps sealed with 1.5-inch heat weld.	-45.0

**TABLE 2E: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: PRELIMINARILY ATTACHED INSULATION, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck (Note 1)	Insulation (Note 14)		Roof Cover			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners	Attach	
S-125.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch total thickness, min. 16-psi top layer	Prelim. attach	Duro-Tuff, min. 50 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with Duro-Last Cleat Plates	<u>Standard Lap System</u> fastened 12-inch o.c. within 4-inch wide laps spaced 116-inch o.c. Laps sealed with 1.5-inch heat weld.	-45.0
S-126.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with Duro-Last 2.4-inch Barbed Metal Plates	<u>Standard Lap System</u> fastened 6-inch o.c. within 3-inch wide tabs spaced 84-inch o.c.	-60.0
S-127.	Min. 22 ga., Type B, 50 ksi steel	One or more layers, any combination, min. 1-inch	Prelim. attach	Duro-Last EV, min. 50-mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Cleat Plate	<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Laps sealed with 1.5-inch heat weld.	-75.0
DURO-ROOF LAP SYSTEMS:							
S-128.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Cleat Plate	<u>Duro-Roof Lap System</u> fastened 12-inch o.c. within 5.75-inch wide tabs spaced 120-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-45.0
S-129.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with Duro-Last 3-inch Metal Plates	<u>Duro-Roof Lap System</u> fastened 12-inch o.c. within 6-inch wide tabs spaced 57-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-52.5
S-130.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Cleat Plate	<u>Duro-Roof Lap System</u> fastened 12-inch o.c. within 5.75-inch wide tabs spaced 84-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-52.5
S-131.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Cleat Plate	<u>Duro-Roof Lap System</u> fastened 12-inch o.c. within 5.75-inch wide tabs spaced 57-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-67.5
S-132.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Batten Bar	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 3-inch wide tabs spaced 60-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-67.5
S-133.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with Duro-Last 3-inch Metal Plates	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 6-inch wide tabs spaced 120-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-82.5
S-134.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Cleat Plate	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 5.75-inch wide tabs spaced 120-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-82.5
S-135.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Cleat Plate	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 5.75-inch wide tabs spaced 84-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-97.5

TABLE 2E: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: PRELIMINARILY ATTACHED INSULATION, MECHANICALLY ATTACHED ROOF COVER

System No.	Deck (Note 1)	Insulation (Note 14)		Roof Cover			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners	Attach	
S-136.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Cleat Plate	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 5.75-inch wide tabs spaced 57-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-135.0
S-137.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fasteners with OMG 2-3/8" Eyehook Plates	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 6-inch wide tabs spaced 25-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-142.5

TABLE 2F: STEEL DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE D-2: THERMAL BARRIER WITH VAPOR BARRIER, PRELIMINARILY ATTACHED INSULATION, MECHANICALLY ATTACHED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier	Vapor Barrier	Insulation			Slip Sheet	Roof Cover			MDP (psf)
				Base	Top	Attach		Membrane	Fasteners	Attach	
S-138.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.25-inch DensDeck Prime, loose-laid, adhered or mech. attached	Duro-Last Vapor Barrier, self-adhering	(Optional) One or more layers DURO-GUARD ISO II-A, DURO-GUARD ISO II-G, DURO-GUARD ISO II-H, DURO-GUARD ISO III-A or DURO-GUARD ISO III-H, DURO-GUARD EPS Type II-C or DURO-GUARD EPS FGF loose-laid	(Optional if using base layer(s) insulation) Min. 0.5-inch DURO-GUARD EPS Type II-C or DURO-GUARD EPS FGF	Duro-Last #14 Heavy Duty with Duro-Last 3-inch Metal Plates; 1 per 5.3 ft ² ; 6 parts per 4x8 ft board	Geotextile slip sheet, loose-laid	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Poly-Plate or Duro-Last Cleat Plate	<u>Standard Lap System</u> fastened 12-inch o.c. within 3-inch wide tabs spaced 60-inch o.c.	-52.5
S-139.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.25-inch DensDeck Prime, loose-laid, adhered or mech. attached	Duro-Last Vapor Barrier, self-adhering	(Optional) One or more layers DURO-GUARD ISO II-A, DURO-GUARD ISO II-G, DURO-GUARD ISO II-H, DURO-GUARD ISO III-A or DURO-GUARD ISO III-H, DURO-GUARD EPS Type II-C or DURO-GUARD EPS FGF loose-laid	(Optional if using base layer(s) insulation) Min. 0.5-inch DURO-GUARD EPS Type II-C or DURO-GUARD EPS FGF	Duro-Last #14 Heavy Duty with Duro-Last 3-inch Metal Plates; 1 per 5.3 ft ² ; 6 parts per 4x8 ft board	Geotextile slip sheet, loose-laid	Duro-Tuff, min. 50 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Poly-Plate or Duro-Last Cleat Plate	<u>Standard Lap System</u> fastened 12-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Side laps sealed with 1.5-inch heat-weld	-52.5

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER
 REFER TO NOTE 17 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
DURO-LAST MEMBRANE APPLICATIONS:							
C-1.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	Min. 0.25-inch DensDeck	Ashland Pliodeck	Duro-Last / WB I	-37.5
C-2.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	(Optional) Additional layers of base insulation	Ashland Pliodeck	Duro-Last / SB I or WB II	-45.0
C-3.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	(Optional) Additional layers of base insulation	Ashland Pliodeck	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
C-4.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	(Optional) Additional layers of base insulation	Ashland Pliodeck	Duro-Last / WB I	-82.5
C-5.	Min. 2,500 psi structural concrete	Min. 2-inch ISO 95+ GL	Ashland Pliodeck	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Ashland Pliodeck	Duro-Last / WB II	-217.5
C-6.	Min. 2,500 psi structural concrete	Min. 2-inch ISO 95+ GL	Ashland Pliodeck	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Ashland Pliodeck	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-217.5
C-7.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Board-Max	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Board-Max	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-247.5
C-8.	Min. 2,500 psi structural concrete	Min. 0.75-inch Duro-Guard EPS Type IX	Board-Max	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Board-Max	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-255.0
C-9.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-247.5
C-10.	Min. 2,500 psi structural concrete	Min. 0.75-inch Duro-Guard EPS Type II, VIII or IX	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-255.0
C-11.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	CR-20	Duro-Last / SB IV	-300.0
C-12.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	CR-20	Duro-Last or Duro-Tuff / WB II	-300.0
C-13.	Min. 2,500 psi structural concrete (ASTM D41 primer)	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Hot asphalt	(Optional) Additional layers of base insulation	Hot asphalt	Duro-Last / SB I or WB II	-45.0
C-14.	Min. 2,500 psi structural concrete (ASTM D41 primer)	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Hot asphalt	(Optional) Additional layers of base insulation	Hot asphalt	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER
 REFER TO NOTE 17 FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
C-15.	Min. 2,500 psi structural concrete (ASTM D41 primer)	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Hot asphalt	(Optional) Additional layers of base insulation	Hot asphalt	Duro-Last / WB I	-75.0
C-16.	Min. 2,500 psi structural concrete (ASTM D41 primer)	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Hot asphalt	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Hot asphalt	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-247.5
C-17.	Min. 2,500 psi structural concrete (ASTM D41 primer)	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Hot asphalt	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Hot asphalt	Duro-Last / SB IV	-495.0
C-18.	Min. 2,500 psi structural concrete (ASTM D41 primer)	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Hot asphalt	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Hot asphalt	Duro-Last or Duro-Tuff / WB II	-495.0
C-19.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	Min. 0.25-inch DensDeck	INSTA STIK Quik Set	Duro-Last / WB I	-37.5
C-20.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	(Optional) Additional layers of base insulation	INSTA STIK Quik Set	Duro-Last / SB I or WB II	-45.0
C-21.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	(Optional) Additional layers of base insulation	INSTA STIK Quik Set	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
C-22.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	(Optional) Additional layers of base insulation	INSTA STIK Quik Set	Duro-Last / WB I	-82.5
C-23.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	INSTA STIK Quik Set	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	INSTA STIK Quik Set	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-247.5
C-24.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	Min. 7/16-inch DEXcell Cement Roof Board	INSTA STIK Quik Set	Duro-Last / SB IV	-382.5
C-25.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	Min. 7/16-inch DEXcell Cement Roof Board	INSTA STIK Quik Set	Duro-Last or Duro-Tuff / WB II	-382.5
C-26.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	M-OSA	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	M-OSA	Duro-Last / SB IV	-382.5
C-27.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	M-OSA	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	M-OSA	Duro-Last or Duro-Tuff / WB II	-382.5
C-28.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	Min. 0.25-inch DensDeck	OlyBond 500	Duro-Last / WB I	-37.5

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER
REFER TO NOTE 17 FOR VAPOR BARRIER OPTIONS**

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
C-29.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	(Optional) Additional layers of base insulation	OlyBond 500	Duro-Last / SB I or WB II	-45.0
C-30.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	(Optional) Additional layers of base insulation	OlyBond 500	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
C-31.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	(Optional) Additional layers of base insulation	OlyBond 500	Duro-Last / WB I	-82.5
C-32.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	OlyBond 500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OlyBond 500	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-247.5
C-33.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	OlyBond 500	Duro-Last / SB IV	-382.5
C-34.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	OlyBond 500	Duro-Last or Duro-Tuff / WB II	-382.5
C-35.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H	OlyBond Classic, full coverage	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OlyBond Classic, full coverage	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-457.5
C-36.	Min. 2,500 psi structural concrete	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Trufast Roofing Adhesive	Min. 0.25-inch DensDeck	Trufast Roofing Adhesive	Duro-Last / WB I	-37.5
C-37.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Trufast Roofing Adhesive	(Optional) Additional layers of base insulation	Trufast Roofing Adhesive	Duro-Last / SB I or WB II	-45.0
C-38.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Trufast Roofing Adhesive	(Optional) Additional layers of base insulation	Trufast Roofing Adhesive	Duro-Last / WB I	-82.5
C-39.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Trufast Roofing Adhesive	(Optional) Additional layers of base insulation	Trufast Roofing Adhesive	Duro-Last or Duro-Tuff / Solvent-Grip Spray Adhesive	-300.0
C-40.	Min. 2,500 psi structural concrete	Min. 1.5-inch H-Shield, Duro-Guard ISO II-H	Trufast Roofing Adhesive	(Optional) Additional layers of base insulation	Trufast Roofing Adhesive	Duro-Last / Solvent-Grip Spray Adhesive	-367.5
C-41.	Min. 2,500 psi structural concrete	Min. 1.5-inch H-Shield, Duro-Guard ISO II-H	Trufast Roofing Adhesive	(Optional) Additional layers of base insulation	Trufast Roofing Adhesive	Duro-Tuff / Solvent-Grip Spray Adhesive	-382.5
C-42.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Trufast Roofing Adhesive	Min. 7/16-inch DEXcell Cement Roof Board	Trufast Roofing Adhesive	Duro-Last / SB IV	-382.5
C-43.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Trufast Roofing Adhesive	Min. 7/16-inch DEXcell Cement Roof Board	Trufast Roofing Adhesive	Duro-Last or Duro-Tuff / WB II	-382.5

DURO-FLEECE OR DURO-FLEECE PLUS MEMBRANE APPLICATIONS:

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER
REFER TO NOTE 17 FOR VAPOR BARRIER OPTIONS**

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
C-44.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	(Optional) Additional layers of base insulation	Ashland Pliodeck	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0
C-45.	Min. 2,500 psi structural concrete	Min. 2-inch ISO 95+ GL	Ashland Pliodeck	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Ashland Pliodeck	Duro-Fleece or Duro-Fleece Plus / WB II	-217.5
C-46.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Board-Max	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Board-Max	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-247.5
C-47.	Min. 2,500 psi structural concrete	Min. 0.75-inch Duro-Guard EPS Type IX	Board-Max	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Board-Max	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-255.0
C-48.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-247.5
C-49.	Min. 2,500 psi structural concrete	Min. 0.75-inch Duro-Guard EPS Type II, VIII or IX	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-255.0
C-50.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	CR-20	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-300.0
C-51.	Min. 2,500 psi structural concrete (ASTM D41 primer)	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Hot asphalt	(Optional) Additional layers of base insulation	Hot asphalt	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0
C-52.	Min. 2,500 psi structural concrete (ASTM D41 primer)	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Hot asphalt	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Hot asphalt	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-247.5
C-53.	Min. 2,500 psi structural concrete (ASTM D41 primer)	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Hot asphalt	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Hot asphalt	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-495.0
C-54.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	(Optional) Additional layers of base insulation	INSTA STIK Quik Set	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER
REFER TO NOTE 17 FOR VAPOR BARRIER OPTIONS**

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
C-55.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	INSTA STIK Quik Set	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	INSTA STIK Quik Set	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-247.5
C-56.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	Min. 7/16-inch DEXcell Cement Roof Board	INSTA STIK Quik Set	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-382.5
C-57.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	M-OSA	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	M-OSA	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-382.5
C-58.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	(Optional) Additional layers of base insulation	OlyBond 500	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0
C-59.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	OlyBond 500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OlyBond 500	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-247.5
C-60.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	OlyBond 500	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-382.5
C-61.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H	OlyBond Classic, full coverage	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OlyBond Classic, full coverage	Duro-Fleece or Duro-Fleece Plus / Trufast Roofing Adhesive (SPLATTER)	-337.5
C-62.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H	OlyBond Classic, full coverage	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OlyBond Classic, full coverage	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-457.5
C-63.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, ENRGY 3 CGF, Duro-Guard ISO III-G, H-Shield CG, Duro-Guard ISO III-H	Trufast Roofing Adhesive	Min. 0.5-inch Duro-Guard ISO HD-A or Duro-Guard ISO HD-H	Trufast Roofing Adhesive	Duro-Fleece or Duro-Fleece Plus / Trufast Roofing Adhesive (RIBBONS, 4" o.c.)	-165.0
C-64.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, ENRGY 3 CGF, Duro-Guard ISO III-G, H-Shield CG, Duro-Guard ISO III-H	Trufast Roofing Adhesive	Min. 0.25-inch DensDeck, DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Glass-Mat Roof Board or min. 7/16" DEXcell Cement Roof Board	Trufast Roofing Adhesive	Duro-Fleece or Duro-Fleece Plus / Trufast Roofing Adhesive (RIBBONS, 4" o.c.)	-195.0
C-65.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, ENRGY 3 CGF, Duro-Guard ISO III-G, H-Shield CG, Duro-Guard ISO III-H	Trufast Roofing Adhesive	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Trufast Roofing Adhesive	Duro-Fleece or Duro-Fleece Plus / Trufast Roofing Adhesive (SPLATTER)	-195.0

**TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER
REFER TO NOTE 17 FOR VAPOR BARRIER OPTIONS**

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
C-66.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, ENRGY 3 CGF, Duro-Guard ISO III-G, H-Shield CG, Duro-Guard ISO III-H	Trufast Roofing Adhesive	(Optional) Additional layers of base insulation	Trufast Roofing Adhesive	Duro-Fleece or Duro-Fleece Plus / Trufast Roofing Adhesive (RIBBONS, 4" o.c.)	-345.0
C-67.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Trufast Roofing Adhesive	Min. 7/16-inch DEXcell Cement Roof Board	Trufast Roofing Adhesive	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPATTER) or WB II	-382.5

**TABLE 3B: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: MECHANICALLY ATTACHED INSULATION, PLATE-BONDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 14)	Attach		Roof Cover / Attach	MDP (psf)
			Fasteners	Density		
RHINO BOND INDUCTION WELD:						
C-68.	Min. 2,500 psi structural concrete	One or more layers, any combination	Duro-Last #14 HD with RHINO BOND Insulation Plate (PVC)	1 per 2.7 ft ² (12 parts per 4 x 8 ft board)	Duro-Last (min. 40-mil), Duro-Tuff (min. 50-mil) or Duro-Last EV (min. 50-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-52.5
C-69.	Min. 2,500 psi structural concrete	One or more layers, any combination, preliminarily attached (Note 5)	Duro-Last #14 HD with RHINO BOND Insulation Plate (PVC)	12-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-37.5
C-70.	Min. 2,500 psi structural concrete	One or more layers, any combination, preliminarily attached (Note 5)	Duro-Last #14 HD with RHINO BOND Insulation Plate (PVC)	12-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-37.5
C-71.	Min. 2,500 psi structural concrete	One or more layers, any combination, preliminarily attached (Note 5)	Duro-Last #14 HD with RHINO BOND Insulation Plate (PVC)	6-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 40-mil), Duro-Tuff (min. 50-mil) or Duro-Last EV (min. 50-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-45.0
C-72.	Min. 2,500 psi structural concrete	One or more layers, any combination, preliminarily attached (Note 5)	Duro-Last #14 HD with RHINO BOND Insulation Plate (PVC)	6-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 40-mil), Duro-Tuff (min. 50-mil) or Duro-Last EV (min. 50-mil) induction welded to RHINO BOND Insulation Plate (PVC) using RHINO BOND Installation Tool	-52.5
ISOWELD INDUCTION WELD:						
C-73.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	SFS Intec Dekfast DF-#14-PH3 or DF-#15-PH3 with <i>isoweld</i> ® F1-P-6.8-PVC Plates	6 ft ² per fastener 2 x 3-ft grid, staggered	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-37.5
C-74.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	SFS Intec Dekfast DF-#14-PH3 or DF-#15-PH3 with <i>isoweld</i> ® F1-P-6.8-PVC Plates	4 ft ² per fastener 2 x 2-ft grid, staggered	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-52.5

**TABLE 3B: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: MECHANICALLY ATTACHED INSULATION, PLATE-BONDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 14)	Attach		Roof Cover / Attach	MDP (psf)
			Fasteners	Density		
C-75.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	SFS Intec Dekfast DF-#14-PH3 or DF-#15-PH3 with <i>isoweld</i> ® F1-P-6.8-PVC Plates	3 ft ² per fastener 1.5 x 2-ft grid, staggered	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-82.5
C-76.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch, preliminarily attached (Note 5)	SFS Intec Dekfast DF-#14-PH3 or DF-#15-PH3 with <i>isoweld</i> ® F1-P-6.8-PVC Plates	12-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-45.0
C-77.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch, preliminarily attached (Note 5)	SFS Intec Dekfast DF-#14-PH3 or DF-#15-PH3 with <i>isoweld</i> ® F1-P-6.8-PVC Plates	6-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 40 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-90.0
TRUFAST INDUCTION WELD:						
C-78.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 5.3 ft ² (6 parts per 4x8 ft board on a 24x36-inch pattern)	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-45.0*
C-79.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 4.0 ft ² (8 parts per 4x8 ft board on a 24x24-inch pattern)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-52.5
C-80.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 4.0 ft ² (8 parts per 4x8 ft board on a 24x24-inch pattern)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-60.0
C-81.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 3.2 ft ² (10 parts per 4x8 ft board on a 24x20-inch pattern)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-60.0
C-82.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 3.2 ft ² (10 parts per 4x8 ft board on a 24x20-inch pattern)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-67.5
C-83.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 2.7 ft ² (12 parts per 4x8 ft board per FM LPDS 1-29)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-67.5
C-84.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 2.7 ft ² (12 parts per 4x8 ft board per FM LPDS 1-29)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-82.5
C-85.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 2.0 ft ² (16 parts per 4x8 ft board on a 12x24-inch pattern)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-90.0
C-86.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 2.0 ft ² (16 parts per 4x8 ft board on a 12x24-inch pattern)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-112.5

**TABLE 3B: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: MECHANICALLY ATTACHED INSULATION, PLATE-BONDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 14)	Attach		Roof Cover / Attach	MDP (psf)
			Fasteners	Density		
C-87.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 1.8 ft ² (18 parts per 4x8 ft board on an 18x16-inch pattern)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-105.0
C-88.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 1.8 ft ² (18 parts per 4x8 ft board on an 18x16-inch pattern)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-120.0
C-89.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 1.3 ft ² (24 parts per 4x8 ft board on a 12x16-inch pattern)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-135.0
C-90.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 1.3 ft ² (24 parts per 4x8 ft board on a 12x16-inch pattern)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-172.5
C-91.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 1.0 ft ² (32 parts per 4x8 ft board per FM LPDS 1-29)	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-142.5
C-92.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	1 per 1.0 ft ² (32 parts per 4x8 ft board per FM LPDS 1-29)	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-217.5
C-93.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	12-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-45.0
C-94.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	12-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-52.5
C-95.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	12-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-60.0
C-96.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	12-inch o.c. in rows spaced 36-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-60.0
C-97.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	12-inch o.c. in rows spaced 36-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-82.5
C-98.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	6-inch o.c. in rows spaced 72-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-67.5

**TABLE 3B: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: MECHANICALLY ATTACHED INSULATION, PLATE-BONDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 14)	Attach		Roof Cover / Attach	MDP (psf)
			Fasteners	Density		
C-99.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	6-inch o.c. in rows spaced 72-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-75.0
C-100.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	6-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-75.0
C-101.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	6-inch o.c. in rows spaced 60-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-90.0
C-102.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	6-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-90.0
C-103.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch, preliminarily attached	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	6-inch o.c. in rows spaced 48-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-112.5
C-104.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	6-inch o.c. in rows spaced 36-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-112.5
C-105.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 2-inch	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast PVC IW Plate	6-inch o.c. in rows spaced 36-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-150.0

**TABLE 3C: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: PRELIMINARILY ATTACHED INSULATION, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck (Note 1)	Insulation (Note 14)		Roof Cover			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners	Attach	
STANDARD LAP SYSTEMS:							
C-106.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination	Prelim. attached	Duro-Last, min. 40 mil	Duro-Last #14 HD Fasteners with Duro-Last Cleat Plates	<u>Standard Lap System</u> fastened 9-inch o.c. within 3-inch wide tabs spaced 60-inch o.c.	-37.5
C-107.	Min. 3,000 psi structural concrete	One or more layers, any combination, min. 1-inch	Prelim. attach	Duro-Last EV, min. 50-mil	Duro-Last Concrete Screw with Duro-Last Poly-Plate	<u>Standard Lap System</u> fastened 12-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Laps sealed with 1.5-inch heat weld.	-45.0
C-108.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination	Prelim. attached	Duro-Last, min. 40 mil	Duro-Last Concrete Screws #14 or Duro-Last Concrete Nails with Duro-Last 2.4-inch Barbed Metal Plates	<u>Standard Lap System</u> fastened 6-inch o.c. within 3-inch wide tabs spaced 84-inch o.c.	-60.0
C-109.	Min. 3,000 psi structural concrete	One or more layers, any combination, min. 1-inch	Prelim. attach	Duro-Last EV, min. 50-mil	Duro-Last Concrete Screw with Duro-Last Cleat Plate	<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Laps sealed with 1.5-inch heat weld.	-75.0
DURO-ROOF LAP SYSTEMS:							
C-110.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination	Prelim. attached	Duro-Last, min. 60 mil	Duro-Last #14 HD Fasteners with Duro-Last Cleat Plates	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 6-inch wide tabs spaced 120-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-37.5
C-111.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination	Prelim. attached	Duro-Last, min. 40 mil	Duro-Last Concrete Screws #14 or Duro-Last Concrete Nails with Duro-Last 3-inch Metal Plates	<u>Duro-Roof Lap System</u> fastened 12-inch o.c. within 6-inch wide tabs spaced 57-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-52.5
C-112.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination	Prelim. attached	Duro-Last, min. 40 mil	Duro-Last Concrete Screws #14 or Duro-Last Concrete Nails with Duro-Last Batten Bar	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 3-inch wide tabs spaced 60-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-67.5
C-113.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination	Prelim. attached	Duro-Last, min. 40 mil,	Duro-Last Concrete Screws #14 or Duro-Last Concrete Nails with Duro-Last 3-inch Metal Plates	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 6-inch wide tabs spaced 120-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-82.5
C-114.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination	Prelim. attached	Duro-Last, min. 40 mil	Duro-Last Concrete Screws #14 or Duro-Last Concrete Nails with OMG 2-3/8" Eyehook Plates	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 6-inch wide tabs spaced 25-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal.	-142.5

**TABLE 3D: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER**

System No.	Deck (Note 1)	Primer	Vapor Barrier	Roof Cover (Note 16)	MDP (psf)
C-115.	Structural concrete	None	Duro-Last Vapor Barrier, self-adhering	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied)	-502.5
C-116.	Structural concrete	ASTM D41	Duro-Last Torch Down Vapor Barrier, torch-applied	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied)	-502.5
C-117.	Structural concrete	None	None	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece WB II Adhesive	-673.0
C-118.	Structural concrete	None	None	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied)	-1,025.0

TABLE 4A: LIGHTWEIGHT CONCRETE OVER STEEL DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	LWIC (Note 15)	Base Insulation Layer		Coverboard		Roof Cover	MDP (psf)
			Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
PRE-EXISTENT CELLULAR LWIC:								
BAREBACK MEMBRANE APPLICATIONS:								
LWC-1.	Min. 22 ga., type BV steel	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	Min. 0.25-inch DensDeck	Ashland Pliodeck	Duro-Last / WB I	-37.5
LWC-2.	Min. 22 ga., type BV steel	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	(Optional) Additional layers of base insulation	Ashland Pliodeck	Duro-Last / SB I or WB II	-45.0
LWC-3.	Min. 22 ga., type BV steel	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	(Optional) Additional layers of base insulation	Ashland Pliodeck	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
LWC-4.	Min. 22 ga., type BV steel	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	Min. 0.25-inch DensDeck	CR-20	Duro-Last / WB I	-37.5
LWC-5.	Min. 22 ga., type BV steel	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last / SB I or WB II	-45.0
LWC-6.	Min. 22 ga., type BV steel	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
DURO-FLEECE AND DURO-FLEECE PLUS MEMBRANE APPLICATIONS:								
LWC-7.	Min. 22 ga., type BV steel	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	(Optional) Additional layers of base insulation	Ashland Pliodeck	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0
LWC-8.	Min. 22 ga., type BV steel	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0

TABLE 4B: LIGHTWEIGHT CONCRETE OVER STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	LWIC (Note 15)	Base Insulation Layer		Coverboard		Roof Cover	MDP (psf)
			Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
PRE-EXISTENT CELLULAR LWIC:								
BAREBACK MEMBRANE APPLICATIONS:								
LWC-9.	Structural concrete	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	Min. 0.25-inch DensDeck	Ashland Pliodeck	Duro-Last / WB I	-37.5
LWC-10.	Structural concrete	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	(Optional) Additional layers of base insulation	Ashland Pliodeck	Duro-Last / SB I or WB II	-45.0

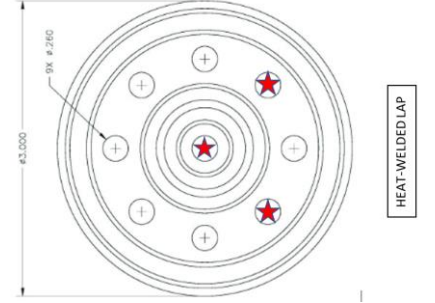
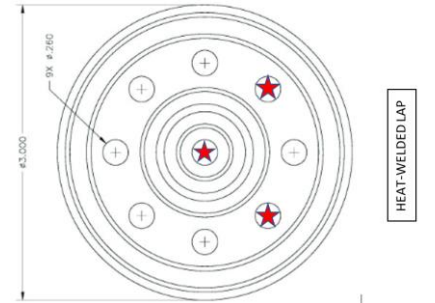
**TABLE 4B: LIGHTWEIGHT CONCRETE OVER STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A: BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	LWIC (Note 15)	Base Insulation Layer		Coverboard		Roof Cover	MDP (psf)
			Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
LWC-11.	Structural concrete	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	(Optional) Additional layers of base insulation	Ashland Pliodeck	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
LWC-12.	Structural concrete	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	Min. 0.25-inch DensDeck	CR-20	Duro-Last / WB I	-37.5
LWC-13.	Structural concrete	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last / SB I or WB II	-45.0
LWC-14.	Structural concrete	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
DURO-FLEECE AND DURO-FLEECE PLUS MEMBRANE APPLICATIONS:								
LWC-15.	Structural concrete	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	(Optional) Additional layers of base insulation	Ashland Pliodeck	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0
LWC-16.	Structural concrete	Min. 200 psi, min. 2-inch thick cellular lightweight insulating concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-45.0
CELCORE (FL2037):								
BAREBACK MEMBRANE APPLICATIONS:								
LWC-17.	Structural concrete	Min. 200 psi, min. 2-inch thick Celcore Cellular Concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last / WB I	-82.5
LWC-18.	Structural concrete	Min. 200 psi, min. 2-inch thick Celcore Cellular Concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-222.5
DURO-FLEECE AND DURO-FLEECE PLUS MEMBRANE APPLICATIONS:								
LWC-19.	Structural concrete	Min. 200 psi, min. 2-inch thick Celcore Cellular Concrete	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-222.5
ELASTIZELL (FL4994):								
BAREBACK MEMBRANE APPLICATIONS:								
LWC-20.	Structural concrete	Min. 200 psi, min. 2-inch thick Elastizell.	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck	(Optional) Additional layers of base insulation	Ashland Pliodeck	Duro-Last / WB I	-82.5

**TABLE 4B: LIGHTWEIGHT CONCRETE OVER STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A: BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	LWIC (Note 15)	Base Insulation Layer		Coverboard		Roof Cover	MDP (psf)
			Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
LWC-21.	Structural concrete	Min. 200 psi, min. 2-inch thick Elastizell.	Min. 2-inch ISO 95+ GL	Ashland Pliodeck	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Ashland Pliodeck	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-105.0
LWC-22.	Structural concrete	Min. 200 psi, min. 2-inch thick Elastizell.	Min. 2-inch ISO 95+ GL	Ashland Pliodeck, 6-inch o.c.	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Ashland Pliodeck, 6-inch o.c.	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-187.5
LWC-23.	Structural concrete	Min. 200 psi, min. 2-inch thick Elastizell	Min. 1.5-inch ACfoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last / WB I	-82.5
LWC-24.	Structural concrete	Min. 200 psi, min. 2-inch thick Elastizell	Min. 1.5-inch ACfoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-180.0
DURO-FLEECE AND DURO-FLEECE PLUS MEMBRANE APPLICATIONS:								
LWC-25.	Structural concrete	Min. 200 psi, min. 2-inch thick Elastizell.	Min. 2-inch ISO 95+ GL	Ashland Pliodeck	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Ashland Pliodeck	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-105.0
LWC-26.	Structural concrete	Min. 200 psi, min. 2-inch thick Elastizell.	Min. 2-inch ISO 95+ GL	Ashland Pliodeck, 6-inch o.c.	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Ashland Pliodeck, 6-inch o.c.	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-187.5
LWC-27.	Structural concrete	Min. 200 psi, min. 2-inch thick Elastizell	Min. 1.5-inch ACfoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-180.0
MEARLCRETE (FL13492):								
BAREBACK MEMBRANE APPLICATIONS:								
LWC-28.	Structural concrete	Min. 200 psi, min. 2-inch thick Mearlcrete	Min. 1.5-inch ACfoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last / WB I	-82.5
LWC-29.	Structural concrete	Min. 200 psi, min. 2-inch thick Mearlcrete	Min. 1.5-inch ACfoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-240.0
DURO-FLEECE AND DURO-FLEECE PLUS MEMBRANE APPLICATIONS:								
LWC-30.	Structural concrete	Min. 200 psi, min. 2-inch thick Mearlcrete	Min. 1.5-inch ACfoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-240.0

**TABLE 4C: LIGHTWEIGHT CONCRETE OVER STEEL DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE E-1: MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck (Note 1)	LWIC (Note 15)	Roof Cover			MDP (psf)	
			Membrane	Fasteners	Attach		
PRE-EXISTENT CELLULAR LWIC:							
LWC-31.	Min. 26 ga., type HVF, Grade 80 steel; 5 ft span; 5/8" puddle weld with weld-washer at each flute.	Min. 330 psi, min. 2-inch thick pre-existent cellular lightweight insulating concrete	Duro-Tuff, min. 50 mil	Trufast Versa-Fast Plates with minimum three (3) min. 2¼" long Versa-Fast Fasteners installed forming a triangle pattern with the center-fastener as the apex to the triangle base, which runs parallel to the machine direction of the roll, and closest to the heat-welded lap.		<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide laps spaced 114-inch o.c. Laps sealed with 1.5-inch heat weld.	-30.0
	<i>Note:</i>	<i>*Field withdrawal resistance testing (Note 11) shall yield minimum 285 lbf for the 3-fastener-per-plate configuration. Additional Versa-Fast Fasteners within each Versa-Fast Plate may be utilized to produce withdrawal resistance.</i>					
LWC-32.	Min. 26 ga., type HVF, Grade 80 steel; 5 ft span; 5/8" puddle weld with weld-washer at each flute.	Min. 480 psi, min. 2-inch thick pre-existent cellular lightweight insulating concrete	Duro-Tuff, min. 50 mil	Trufast Versa-Fast Plates with minimum three (3) min. 2¼" long Versa-Fast Fasteners installed forming a triangle pattern with the center-fastener as the apex to the triangle base, which runs parallel to the machine direction of the roll, and closest to the heat-welded lap.		<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Laps sealed with 1.5-inch heat weld.	-37.5
	<i>Note:</i>	<i>*Field withdrawal resistance testing (Note 11) shall yield minimum 169 lbf for the 3-fastener-per-plate configuration. Additional Versa-Fast Fasteners within each Versa-Fast Plate may be utilized to produce withdrawal resistance.</i>					

**TABLE 4D: LIGHTWEIGHT CONCRETE OVER STEEL DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE E-2: MECHANICALLY ATTACHED BASE SHEET, BONDED ROOF COVER**

System No.	Deck (Note 1)	LWIC (Note 15)	Base Sheet			Roof Cover (Note 16)	MDP (psf)
			Type	Fasteners	Attach		
ELASTIZELL (FL4994):							
LWC-33.	Min. 22 ga., type BV, Grade 33 steel at max. 7 ft spans	Min. 320 psi, min. 2-inch thick Elastizell cellular lightweight concrete cast with Zell Fibers in the mix.	CertainTeed Flexiglas Base Sheet, GAFGLAS #75, GAFGLAS Stratavent Nailable Base Sheet	Trufast FM-90	7.5-inch o.c. at the 3-inch laps and 7.5-inch o.c. in one staggered row in the center of the sheet	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied)	-22.5
LWC-34.	Min. 22 ga., type BV, Grade 33 steel at max. 7 ft spans	Min. 380 psi, min. 2-inch thick Elastizell cellular lightweight concrete cast with Zell Fibers in the mix.	CertainTeed Flexiglas Base Sheet, GAFGLAS #75, GAFGLAS Stratavent Nailable Base Sheet, JM PermaPly 28	Trufast Twin-Loc Nails (min. 1.8-in)	7.5-inch o.c. at the 3-inch laps and 7.5-inch o.c. in one staggered row in the center of the sheet	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied)	-37.5
LWC-35.	Min. 22 ga., type BV, Grade 33 steel at max. 7 ft spans	Min. 350 psi, min. 2-inch thick Elastizell cellular lightweight concrete cast with Zell Fibers in the mix.	CertainTeed Flexiglas Base Sheet, GAFGLAS #75, GAFGLAS Stratavent Nailable Base Sheet, JM PermaPly 28	Trufast Twin-Loc Nails (min. 1.8-in)	7.5-inch o.c. at the 3-inch laps and 7.5-inch o.c. in two, equally spaced, staggered row in the center of the sheet	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied)	-67.5

**TABLE 4E: LIGHTWEIGHT CONCRETE OVER STEEL DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER**

System No.	Deck (Note 1)	LWIC (Note 15)	Roof Cover (Note 16)	MDP (psf)
CELCORE (FL2037):				
LWC-36.	Min. 22 ga., type BV, Grade 33 steel deck at max. 4 ft spans	Min. 350 psi, min. 2-inch thick Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture, with optional 1-inch thick, 1.0 pcf EPS holey board and surfacing of Celcore PVA Curing Compound.	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece Adhesive	-37.5
LWC-37.	Min. 22 ga., type BV, Grade 33 steel deck at max. 6 ft spans	Min. 350 psi, min. 2-inch thick Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture, with optional 1-inch thick, 1.0 pcf EPS holey board and surfacing of Celcore PVA Curing Compound.	Duro-Fleece or Duro-Fleece Plus / WB II	-60.0
ELASTIZELL (FL4994):				
LWC-38.	Min. 22 ga., type BV, Grade 33 steel at max. 7 ft spans	Min. 350 psi, min. 2-inch thick Elastizell cellular lightweight concrete cast with Zell Fibers in the mix.	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied)	-52.5

**TABLE 4F: LIGHTWEIGHT CONCRETE OVER STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER**

System No.	Deck (Note 1)	LWIC (Note 15)	Roof Cover (Note 16)	MDP (psf)
PRE-EXISTENT CELLULAR LWIC:				
LWC-39.	Min. 2,500 psi structural concrete	Min. 440 psi, min. 2-inch thick pre-existent cellular lightweight concrete. No EPS holey board. <i>To qualify the LWIC under this assembly, an OMG CR Assembled Base Sheet Fastener (1.7") shall achieve an average withdrawal of 128 lbf when tested per ANSI/SPRI FX-1 or TAS 105.</i>	Duro-Last, Duro-Last EV or Duro-Tuff / SB-IV	-407.5
LWC-40.	Min. 2,500 psi structural concrete	Min. 440 psi, min. 2-inch thick pre-existent cellular lightweight concrete. No EPS holey board. <i>To qualify the LWIC under this assembly, an OMG CR Assembled Base Sheet Fastener (1.7") shall achieve an average withdrawal of 128 lbf when tested per ANSI/SPRI FX-1 or TAS 105.</i>	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 Membrane Adhesive at 5 lbs/square.	-477.5
LWC-41.	Min. 2,500 psi structural concrete	Min. 440 psi, min. 2-inch thick pre-existent cellular lightweight concrete. No EPS holey board. <i>To qualify the LWIC under this assembly, an OMG CR Assembled Base Sheet Fastener (1.7") shall achieve an average withdrawal of 128 lbf when tested per ANSI/SPRI FX-1 or TAS 105.</i>	Duro-Last, Duro-Last EV or Duro-Tuff / WB II	-502.5
CELCORE (FL2037):				
LWC-42.	Min. 2,500 psi structural concrete	Min. 350 psi, min. 2-inch thick Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture, with optional 1-inch thick, 1.0 pcf EPS holey board and surfacing of Celcore PVA Curing Compound.	Duro-Fleece or Duro-Fleece Plus / WB II	-82.5
LWC-43.	Min. 2,500 psi structural concrete	Min. 350 psi, min. 2-inch thick Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture, with optional 1-inch thick, 1.0 pcf EPS holey board and surfacing of Celcore PVA Curing Compound.	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece Adhesive at 4-inch o.c.	-232.5
CONCRECEL (FL5584 & FL10500):				
LWC-44.	Min. 2,500 psi structural concrete	Min. 440 psi, min. 2-inch thick Concrecel Lightweight Insulating Concrete. No EPS holey board.	Duro-Last, Duro-Last EV or Duro-Tuff / WB II	-372.5
LWC-45.	Min. 2,500 psi structural concrete	Min. 440 psi, min. 2-inch thick Concrecel Lightweight Insulating Concrete. No EPS holey board.	Duro-Last, Duro-Last EV or Duro-Tuff / SB-IV	-490.0
LWC-46.	Min. 2,500 psi structural concrete	Min. 440 psi, min. 2-inch thick Concrecel Lightweight Insulating Concrete. No EPS holey board.	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 Membrane Adhesive at 5 lbs/square.	-492.5
LWC-47.	Min. 2,500 psi structural concrete	Min. 440 psi, min. 2-inch thick Concrecel Lightweight Insulating Concrete. No EPS holey board.	Duro-Fleece or Duro-Fleece Plus / WB II	-502.5
ELASTIZELL (FL4994):				
LWC-48.	Min. 2,500 psi structural concrete	Min. 310 psi, min. 2-inch thick Elastizell Lightweight Insulating Concrete. No EPS holey board.	Duro-Last, Duro-Last EV or Duro-Tuff / WB II	-412.5
LWC-49.	Min. 2,500 psi structural concrete	Min. 310 psi, min. 2-inch thick Elastizell Lightweight Insulating Concrete. No EPS holey board.	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 Membrane Adhesive at 5 lbs/square.	-462.5
LWC-50.	Min. 2,500 psi structural concrete	Min. 310 psi, min. 2-inch thick Elastizell Lightweight Insulating Concrete. No EPS holey board.	Duro-Last, Duro-Last EV or Duro-Tuff / SB-IV	-492.5
LWC-51.	Min. 2,500 psi structural concrete	Min. 310 psi, min. 2-inch thick Elastizell Lightweight Insulating Concrete. No EPS holey board.	Duro-Fleece or Duro-Fleece Plus / WB II	-502.5

**TABLE 5A: CEMENTITIOUS WOOD FIBER DECKS - REROOF (TEAR-OFF)
SYSTEM TYPE A: BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck (Notes 1 & 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach	Type	Attach (Note 6,7&8)		
CWF-1.	Existing min. 2.5-inch Tectum Plank or Tectum LS Plank	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	INSTA STIK Quik Set, 6-inch o.c.	None	N/A	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-150.0
CWF-2.	Existing min. 2.5-inch Tectum Plank or Tectum LS Plank	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	INSTA STIK Quik Set, 6-inch o.c.	None	N/A	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-150.0

**TABLE 5B: CEMENTITIOUS WOOD FIBER DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: PRELIMINARILY ATTACHED INSULATION, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck (Note 1)	Insulation (Note 14)		Roof Cover			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners	Attach	
CWF-3.	Min. 3-inch Tectum I	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40-mil	Duro-Last Auger Fastener (min. 2-inch embedment) with 2" Auger Plate	<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide tabs spaced 57-inch o.c.	-45.0
CWF-4.	Min. 3-inch Tectum I	One or more layers, any combination, min. 1.5-inch	Prelim. attach	Duro-Last, min. 40-mil	Duro-Last Auger Fastener (min. 2-inch embedment) with 2" Auger Plate	<u>Duro-Roof Lap System</u> fastened 6-inch o.c. within 6-inch wide tabs spaced 57-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal	-52.5

**TABLE 5C: CEMENTITIOUS WOOD FIBER DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE E-1: NON-INSULATED, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck (Note 1)	Roof Cover				MDP (psf)
		Membrane	Fasteners		Attach	
			Type	ENERFOAM Installation		
CWF-5.	Min. 2-inch Tectum I	Duro-Last, min. 40-mil	Duro-Last Auger Fastener (min. 2-inch embedment)	N/A	<u>Standard Lap System</u> fastened 6-inch o.c. at 3-inch wide tabs spaced 60-inch o.c.	-30.0
CWF-6.	Min. 3-inch Tectum I	Duro-Last, min. 40-mil	Duro-Last Auger Fastener (min. 2-inch embedment) with 2" Auger Plate and Dupont ENERFOAM™	7/16-inch diameter x 2.5-inch deep pilot hole filled with Dupont ENERFOAM followed by fastener installation within 20-40 seconds after dispensing the foam	<u>Standard Lap System</u> fastened 6-inch o.c. at 3-inch wide tabs spaced 60-inch o.c.	-37.5

**TABLE 6A: GYPSUM DECKS - REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

System No.	Deck (Notes 1 & 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
BAREBACK MEMBRANE APPLICATIONS:							
G-1.	Existing poured gypsum or gypsum plank	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	Min. 0.25-inch DensDeck	CR-20	Duro-Last / WB I	-37.5
G-2.	Existing poured gypsum or gypsum plank	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last / SB I or WB II	-45.0
G-3.	Existing poured gypsum or gypsum plank	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
G-4.	Existing poured gypsum or gypsum plank	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last / WB I	-82.5
G-5.	Existing poured gypsum or gypsum plank	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-247.5
DURO-FLEECE OR DURO-FLEECE PLUS MEMBRANE APPLICATIONS:							
G-6.	Existing poured gypsum or gypsum plank	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0
G-7.	Existing poured gypsum or gypsum plank	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-247.5
G-8.	Existing poured gypsum or gypsum plank	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, ENRGY 3 CGF, Duro-Guard ISO III-G, H-Shield CG, Duro-Guard ISO III-H	Trufast Roofing Adhesive	Min. 0.5-inch Duro-Guard ISO HD-A or Duro-Guard ISO HD-H	Trufast Roofing Adhesive	Duro-Fleece or Duro-Fleece Plus / Trufast Roofing Adhesive (RIBBONS, 4" o.c.)	-165.0
G-9.	Existing poured gypsum or gypsum plank	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, ENRGY 3 CGF, Duro-Guard ISO III-G, H-Shield CG, Duro-Guard ISO III-H	Trufast Roofing Adhesive	Min. 0.25-inch DensDeck, DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Glass-Mat Roof Board or min. 7/16" DEXcell Cement Roof Board	Trufast Roofing Adhesive	Duro-Fleece or Duro-Fleece Plus / Trufast Roofing Adhesive (RIBBONS, 4" o.c.)	-195.0
G-10.	Existing poured gypsum or gypsum plank	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, ENRGY 3 CGF, Duro-Guard ISO III-G, H-Shield CG, Duro-Guard ISO III-H	Trufast Roofing Adhesive	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Trufast Roofing Adhesive	Duro-Fleece or Duro-Fleece Plus / Trufast Roofing Adhesive (SPLATTER)	-195.0
G-11.	Existing poured gypsum or gypsum plank	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, ENRGY 3 CGF, Duro-Guard ISO III-G, H-Shield CG, Duro-Guard ISO III-H	Trufast Roofing Adhesive	(Optional) Additional layers of base insulation	Trufast Roofing Adhesive	Duro-Fleece or Duro-Fleece Plus / Trufast Roofing Adhesive (RIBBONS, 4" o.c.)	-217.5

TABLE 6B: GYPSUM DECKS - REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: PRELIMINARILY ATTACHED INSULATION, MECHANICALLY ATTACHED ROOF COVER

System No.	Deck (Note 1)	Insulation		Roof Cover			MDP (psf)
		Type	Attach	Membrane	Fasteners (Note 11)	Attach	
G-12.	Existing poured gypsum or gypsum plank	One or more layers, any combination	Prelim. Attached	Duro-Last, min. 40 mil,	Duro-Last Auger Fastener with 2" Auger Plate	Standard Lap System fastened 6-inch o.c. within 6-inch wide tabs spaced 57-inch o.c.	-45.0
G-13.	Existing poured gypsum or gypsum plank	One or more layers, any combination	Prelim. attached	Duro-Last, min. 40 mil,	Duro-Last Auger Fastener with 2" Auger Plate	Duro-Roof Lap System fastened 6-inch o.c. within 6-inch wide tabs spaced 57-inch o.c. Tab Sealer 4725 at max. 60 ft ² /gal	-60.0

TABLE 7A: RECOVER APPLICATIONS
SYSTEM TYPE A: BONDED INSULATION, BONDED ROOF COVER

System No.	Substrate (Notes 1 & 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
BAREBACK MEMBRANE APPLICATIONS:							
R-1.	Existing asphaltic BUR or mineral surface cap sheet	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck, 6-inch o.c.	Min. 0.25-inch DensDeck	Ashland Pliodeck, 6-inch o.c.	Duro-Last / WB I	-37.5
R-2.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck, 6-inch o.c.	(Optional) Additional layers of base insulation	Ashland Pliodeck, 6-inch o.c.	Duro-Last / SB I or WB II	-45.0
R-3.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck, 6-inch o.c.	(Optional) Additional layers of base insulation	Ashland Pliodeck, 6-inch o.c.	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
R-4.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck, 6-inch o.c.	(Optional) Additional layers of base insulation	Ashland Pliodeck, 6-inch o.c.	Duro-Last / WB I	-82.5
R-5.	Existing asphaltic BUR or mineral surface cap sheet	Min. 2-inch ISO 95+ GL	Ashland Pliodeck, 6-inch o.c.	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Ashland Pliodeck, 6-inch o.c.	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-172.5
R-6.	Existing asphaltic BUR or mineral surface cap sheet	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Board-Max	Min. 0.25-inch DensDeck	Board-Max	Duro-Last / WB I	-37.5
R-7.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Board-Max	(Optional) Additional layers of base insulation	Board-Max	Duro-Last / SB I or WB II	-45.0
R-8.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Board-Max	(Optional) Additional layers of base insulation	Board-Max	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
R-9.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Board-Max	(Optional) Additional layers of base insulation	Board-Max	Duro-Last / WB I	-82.5
R-10.	Existing smooth surface BUR or granule surface modified bitumen	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Board-Max	None	N/A	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-245.0

TABLE 7A: RECOVER APPLICATIONS
SYSTEM TYPE A: BONDED INSULATION, BONDED ROOF COVER

System No.	Substrate (Notes 1 & 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
R-11.	Existing smooth surface BUR or granule surface modified bitumen	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Board-Max	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Board-Max	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-247.5
R-12.	Existing smooth-surface asphalt BUR or granule-surface modified bitumen	Min. 0.75-inch Duro-Guard EPS Type IX	Board-Max	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Board-Max	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-255.0
R-13.	Existing asphaltic BUR or mineral surface cap sheet	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	Min. 0.25-inch DensDeck	CR-20	Duro-Last / WB I	-37.5
R-14.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last / SB I or WB II	-45.0
R-15.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
R-16.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Last / WB I	-82.5
R-17.	Existing smooth surface modified bitumen	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-222.5
R-18.	Existing smooth-surface SBS modified bitumen	Min. 0.75-inch Duro-Guard EPS Type II, VIII or IX	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-222.5
R-19.	Existing smooth surface BUR or granule surface modified bitumen	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	None	N/A	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-245.0
R-20.	Existing smooth surface BUR or granule surface modified bitumen	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-247.5
R-21.	Existing smooth-surface asphalt BUR or granule-surface modified bitumen	Min. 0.75-inch Duro-Guard EPS Type II, VIII or IX	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-255.0
R-22.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Hot asphalt	(Optional) Additional layers of base insulation	Hot asphalt	Duro-Last / SB I or WB II	-45.0
R-23.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Hot asphalt	(Optional) Additional layers of base insulation	Hot asphalt	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
R-24.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Hot asphalt	(Optional) Additional layers of base insulation	Hot asphalt	Duro-Last / WB I	-75.0
R-25.	Existing asphaltic BUR or mineral surface cap sheet	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	Min. 0.25-inch DensDeck	INSTA STIK Quik Set	Duro-Last / WB I	-37.5

TABLE 7A: RECOVER APPLICATIONS
SYSTEM TYPE A: BONDED INSULATION, BONDED ROOF COVER

System No.	Substrate (Notes 1 & 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
R-26.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	(Optional) Additional layers of base insulation	INSTA STIK Quik Set	Duro-Last / SB I or WB II	-45.0
R-27.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	(Optional) Additional layers of base insulation	INSTA STIK Quik Set	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
R-28.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	(Optional) Additional layers of base insulation	INSTA STIK Quik Set	Duro-Last / WB I	-82.5
R-29.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	INSTA STIK Quik Set	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	INSTA STIK Quik Set	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-127.5
R-30.	Existing asphalt built-up roof	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	Min. 0.25-inch DensDeck	OlyBond 500	Duro-Last / WB I	-37.5
R-31.	Existing asphalt built-up roof	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	(Optional) Additional layers of base insulation	OlyBond 500	Duro-Last / SB I or WB II	-45.0
R-32.	Existing asphalt built-up roof	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	(Optional) Additional layers of base insulation	OlyBond 500	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-45.0
R-33.	Existing asphalt built-up roof	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	(Optional) Additional layers of base insulation	OlyBond 500	Duro-Last / WB I	-82.5
R-34.	Existing asphalt built-up roof	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	OlyBond 500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OlyBond 500	Duro-Last, Duro-Last EV or Duro-Tuff / SB IV or WB II	-120.0
DURO-FLEECE OR DURO-FLEECE PLUS MEMBRANE APPLICATIONS:							
R-35.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Ashland Pliodeck, 6-inch o.c.	(Optional) Additional layers of base insulation	Ashland Pliodeck, 6-inch o.c.	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0
R-36.	Existing asphaltic BUR or mineral surface cap sheet	Min. 2-inch ISO 95+ GL	Ashland Pliodeck, 6-inch o.c.	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Ashland Pliodeck, 6-inch o.c.	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-172.5
R-37.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Board-Max	(Optional) Additional layers of base insulation	Board-Max	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0
R-38.	Existing smooth surface BUR or granule surface modified bitumen	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Board-Max	None	N/A	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-245.0
R-39.	Existing smooth surface BUR or granule surface modified bitumen	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	Board-Max	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Board-Max	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-247.5

TABLE 7A: RECOVER APPLICATIONS
SYSTEM TYPE A: BONDED INSULATION, BONDED ROOF COVER

System No.	Substrate (Notes 1 & 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 16)	MDP (psf)
		Type	Attach (Note 6,7&8)	Type	Attach (Note 6,7&8)		
R-40.	Existing smooth-surface asphalt BUR or granule-surface modified bitumen	Min. 0.75-inch Duro-Guard EPS Type IX	Board-Max	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Board-Max	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-255.0
R-41.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	CR-20	(Optional) Additional layers of base insulation	CR-20	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0
R-42.	Existing smooth surface modified bitumen	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-222.5
R-43.	Existing smooth-surface SBS modified bitumen	Min. 0.75-inch Duro-Guard EPS Type II, VIII or IX	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-222.5
R-44.	Existing smooth surface BUR or granule surface modified bitumen	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	None	N/A	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-245.0
R-45.	Existing smooth surface BUR or granule surface modified bitumen	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER) or WB II	-247.5
R-46.	Existing smooth-surface asphalt BUR or granule-surface modified bitumen	Min. 0.75-inch Duro-Guard EPS Type II, VIII or IX	CR-20	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	CR-20	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-255.0
R-47.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	Hot asphalt	(Optional) Additional layers of base insulation	Hot asphalt	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0
R-48.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	INSTA STIK Quik Set	(Optional) Additional layers of base insulation	INSTA STIK Quik Set	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0
R-49.	Existing asphaltic BUR or mineral surface cap sheet	Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	INSTA STIK Quik Set	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	INSTA STIK Quik Set	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-127.5
R-50.	Existing asphalt built-up roof	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A	OlyBond 500	(Optional) Additional layers of base insulation	OlyBond 500	Duro-Fleece or Duro-Fleece Plus / WB II	-45.0
R-51.	Existing asphalt built-up roof	(Optional) Min. 1.5-inch ACFoam II, Duro-Guard ISO II-A, H-Shield, Duro-Guard ISO II-H, ENRGY 3 or Duro-Guard ISO II-G	OlyBond 500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OlyBond 500	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (SPLATTER), Trufast Roofing Adhesive (SPLATTER) or WB II	-120.0

**TABLE 7B: RECOVER OVER STEEL SUBSTRATE
SYSTEM TYPE C-2: PLATE-BONDED ROOF COVER**

(All areas where the existing metal panels do not lay flush on the underlying purlin shall have a 0.25-inch diameter pilot hole pre-drilled into the panel prior to driving the Purlin Fastener into the purlin.)

System No.	Substrate (Note 1)	Insulation Layer	Attachment		Roof Cover	MDP (psf)
			Fasteners (Note 11)	Spacing		
RHINOBOND INDUCTION WELD:						
R-52.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fasteners with RHINOBOND Insulation Plate (PVC)	12-inch o.c. along purlins 60-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINOBOND Insulation Plate (PVC) using RHINOBOND Installation Tool	-30.0
R-53.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 120-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fasteners with RHINOBOND Insulation Plate (PVC)	6-inch o.c. along purlins 120-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINOBOND Insulation Plate (PVC) using RHINOBOND Installation Tool	-45.0
R-54.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 48-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fasteners with RHINOBOND Insulation Plate (PVC)	12-inch o.c. along purlins 48-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINOBOND Insulation Plate (PVC) using RHINOBOND Installation Tool	-45.0
R-55.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 72-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fasteners with RHINOBOND Insulation Plate (PVC)	6-inch o.c. along purlins 72-inch o.c.	Duro-Last (min. 40-mil), Duro-Tuff (min. 50-mil) or Duro-Last EV (min. 50-mil) induction welded to RHINOBOND Insulation Plate (PVC) using RHINOBOND Installation Tool	-52.5
R-56.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 96-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fasteners with RHINOBOND Insulation Plate (PVC)	6-inch o.c. along purlins 96-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINOBOND Insulation Plate (PVC) using RHINOBOND Installation Tool	-52.5
R-57.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 48-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fasteners with RHINOBOND Insulation Plate (PVC)	6-inch o.c. along purlins 48-inch o.c.	Duro-Last (min. 40-mil), Duro-Tuff (min. 50-mil) or Duro-Last EV (min. 50-mil) induction welded to RHINOBOND Insulation Plate (PVC) using RHINOBOND Installation Tool	-82.5
R-58.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fasteners with RHINOBOND Insulation Plate (PVC)	6-inch o.c. along purlins 60-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINOBOND Insulation Plate (PVC) using RHINOBOND Installation Tool	-82.5
R-59.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 48-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fasteners with RHINOBOND Insulation Plate (PVC)	6-inch o.c. along purlins 48-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 80-mil) induction welded to RHINOBOND Insulation Plate (PVC) using RHINOBOND Installation Tool	-90.0
ISOWELD INDUCTION WELD:						
R-60.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, preliminarily fastened	SFS Purlin Fastener with <i>isoweld</i> ® F1-P-6.8-PVC Plates	12-inch o.c. along purlins 60-inch o.c.	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-45.0

**TABLE 7B: RECOVER OVER STEEL SUBSTRATE
SYSTEM TYPE C-2: PLATE-BONDED ROOF COVER**

(All areas where the existing metal panels do not lay flush on the underlying purlin shall have a 0.25-inch diameter pilot hole pre-drilled into the panel prior to driving the Purlin Fastener into the purlin.)

System No.	Substrate (Note 1)	Insulation Layer	Attachment		Roof Cover	MDP (psf)
			Fasteners (Note 11)	Spacing		
R-61.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, preliminarily fastened	SFS Purlin Fastener with <i>isoweld</i> ® F1-P-6.8-PVC Plates	6-inch o.c. along purlins 60-inch o.c.	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to SFS <i>isoweld</i> ® F1-P-6.8-PVC Plates with SFS <i>isoweld</i> ® 3000 stand-up tool	-90.0
TRUFAST INDUCTION WELD:						
R-62.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	12-inch o.c. along purlins 60-inch o.c.	Duro-Last (min. 40 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-45.0
R-63.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 48-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	12-inch o.c. along purlins 48-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-52.5
R-64.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 48-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	12-inch o.c. along purlins 48-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-60.0
R-65.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 36-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	12-inch o.c. along purlins 36-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-60.0
R-66.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 36-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	12-inch o.c. along purlins 36-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-82.5
R-67.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 72-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	6-inch o.c. along purlins 72-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-67.5
R-68.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 72-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	6-inch o.c. along purlins 72-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-75.0
R-69.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	6-inch o.c. along purlins 60-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-75.0
R-70.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	6-inch o.c. along purlins 60-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-90.0

**TABLE 7B: RECOVER OVER STEEL SUBSTRATE
SYSTEM TYPE C-2: PLATE-BONDED ROOF COVER**

(All areas where the existing metal panels do not lay flush on the underlying purlin shall have a 0.25-inch diameter pilot hole pre-drilled into the panel prior to driving the Purlin Fastener into the purlin.)

System No.	Substrate (Note 1)	Insulation Layer	Attachment		Roof Cover	MDP (psf)
			Fasteners (Note 11)	Spacing		
R-71.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 48-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	6-inch o.c. along purlins 48-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-90.0
R-72.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 48-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	6-inch o.c. along purlins 48-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-112.5
R-73.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 36-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	6-inch o.c. along purlins 36-inch o.c.	Duro-Last (min. 40 mil) or Duro-Tuff (min. 50 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-112.5
R-74.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 36-inch o.c.	One or more layers, any combination, preliminarily fastened	Trufast #12 Purlin Fastener with Trufast PVC IW Plate	6-inch o.c. along purlins 36-inch o.c.	Duro-Last (min. 60 mil), Duro-Last EV (min. 50 mil) or Duro-Tuff (min. 60 mil) induction welded to Trufast PVC IW Plates with Trufast Induction Welding Tool and Magnets	-150.0

TABLE 7C: RECOVER OVER STEEL SUBSTRATE

SYSTEM TYPE D-1: PRELIMINARILY ATTACHED INSULATION, MECHANICALLY ATTACHED ROOF COVER

(All areas where the existing metal panels do not lay flush on the underlying purlin shall have a 0.25-inch diameter pilot hole pre-drilled into the panel prior to driving the Purlin Fastener into the purlin.)

System No.	Substrate (Note 1)	Insulation (Note 14)		Roof Cover			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners (Note 11)	Attachment	
R-75.	Min. 22 ga., Type B, Grade 60 steel with existing single ply roof cover	One or more layers, any combination	Prelim. attached	Duro-Tuff, min. 50 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Poly-Plate	<u>Standard Lap System</u> fastened 12-inch o.c. within 6-inch wide laps spaced 114-inch o.c. Laps sealed with 1.5-inch heat weld.	-22.5
R-76.	Min. 22 ga., Type B, Grade 60 steel with existing single ply roof cover	One or more layers, any combination	Prelim. attached	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Cleat Plates	<u>Standard Lap System</u> fastened 12-inch o.c. within 3-inch wide tabs spaced 60-inch o.c.	-30.0
R-77.	Min. 22 ga., Type B, Grade 60 steel with existing single ply roof cover	One or more layers, any combination	Prelim. attached	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Cleat Plates	<u>Standard Lap System</u> fastened 12-inch o.c. within 6-inch wide tabs spaced 120-inch o.c.	-30.0
R-78.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi or min. 12 gauge (0.105 in.), 36 ksi steel purlins spaced max. 120-inch o.c.	One or more layers, any combination	Prelim. attached	Duro-Last, min. 40 mil	Trufast #12 Purlin Fasteners with Duro-Last Poly-Plate	<u>Standard Lap System</u> fastened 9-inch o.c. within 3-inch wide tabs spaced 60-inch o.c. along purlins	-45.0

TABLE 7C: RECOVER OVER STEEL SUBSTRATE
SYSTEM TYPE D-1: PRELIMINARILY ATTACHED INSULATION, MECHANICALLY ATTACHED ROOF COVER

(All areas where the existing metal panels do not lay flush on the underlying purlin shall have a 0.25-inch diameter pilot hole pre-drilled into the panel prior to driving the Purlin Fastener into the purlin.)

System No.	Substrate (Note 1)	Insulation (Note 14)		Roof Cover			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners (Note 11)	Attachment	
R-79.	Min. 22 ga., Type B, Grade 40 steel with existing asphalt built-up roof (BUR)	Min. 0.5-inch DURO-GUARD EPS FAN FOLD or 3/8-inch DURO-GUARD XPS FAN FOLD	Duro-Last #14 Heavy Duty with Duro-Last 3-inch Metal Plates; 1 per 5.3 ft ² ; 6 parts per 4x8 ft section	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Poly-Plate or Duro-Last Cleat Plate	<u>Standard Lap System</u> fastened 12-inch o.c. within 3-inch wide tabs spaced 60-inch o.c.	-52.5
R-80.	Min. 22 ga., Type B, Grade 40 steel with existing asphalt built-up roof (BUR)	Min. 0.5-inch DURO-GUARD EPS FAN FOLD or 3/8-inch DURO-GUARD XPS FAN FOLD	Duro-Last #14 Heavy Duty with Duro-Last 3-inch Metal Plates; 1 per 5.3 ft ² ; 6 parts per 4x8 ft section	Duro-Tuff, min. 50 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Poly-Plate or Duro-Last Cleat Plate	<u>Standard Lap System</u> fastened 12-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Side laps sealed with 1.5-inch heat-weld	-52.5
R-81.	Min. 26 ga., type HVF, Grade 80 steel; 5 ft span; 5/8" puddle weld with weld-washer at each flute followed by min. 330 psi, min. 2-inch thick cellular lightweight insulating concrete and existing single ply roof membrane	Min. 0.5-inch DURO-GUARD EPS FAN FOLD or 3/8-inch DURO-GUARD XPS FAN FOLD	Loose-laid	Duro-Last, min. 40 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Poly-Plate or Duro-Last Cleat Plate	<u>Standard Lap System</u> fastened 6-inch o.c. within 3-inch wide tabs spaced 60-inch o.c.	-60.0
R-82.	Min. 26 ga., type HVF, Grade 80 steel; 5 ft span; 5/8" puddle weld with weld-washer at each flute followed by min. 330 psi, min. 2-inch thick cellular lightweight insulating concrete and existing single ply roof membrane	Min. 0.5-inch DURO-GUARD EPS FAN FOLD or 3/8-inch DURO-GUARD XPS FAN FOLD	Loose-laid	Duro-Tuff, min. 50 mil	Duro-Last #15 Extra Heavy Duty Drill Point Fastener with Duro-Last Poly-Plate or Duro-Last Cleat Plate	<u>Standard Lap System</u> fastened 6-inch o.c. within 6-inch wide laps spaced 54-inch o.c. Side laps sealed with 1.5-inch heat-weld	-60.0

**TABLE 7D: RECOVER OVER CEMENTITIOUS WOOD FIBER SUBSTRATE
SYSTEM TYPE E-1: NON-INSULATED, MECHANICALLY ATTACHED ROOF COVER**

System No.	Substrate (Note 1)	Roof Cover				MDP (psf)
		Membrane	Fasteners (Note 11)		Attach	
			Type	ENERFOAM Installation		
R-83.	Min. 2-inch Tectum I with existing single ply roof cover	Duro-Last, min. 40-mil	Duro-Last Auger Fastener (min. 2-inch embedment)	N/A	<u>Through-fastened 6-inch o.c. in rows 48-inch o.c. Fastener rows sealed with 10-inch wide strip of Duro-Last, with a 1.5-inch heat weld on all sides</u>	-30.0
R-84.	Min. 3-inch Tectum I with existing single ply roof cover	Duro-Last, min. 40-mil	Duro-Last Auger Fastener (min. 2-inch embedment) with 2" Auger Plate and Dupont ENERFOAM™	7/16-inch diameter x 2.5-inch deep pilot hole filled with Dupont ENERFOAM followed by fastener installation within 20-40 seconds after dispensing the foam	<u>Through-fastened 6-inch o.c. in rows 96-inch o.c. Fastener rows sealed with 10-inch wide strip of Duro-Last, with a 1.5-inch heat weld on all sides</u>	-67.5

**TABLE 7E: RECOVER APPLICATIONS
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER**

System No.	Substrate (Notes 1 & 12)	Primer / Treatment	Roof Cover (Note 16)	MDP (psf)
R-85.	Existing asphaltic roof system with mechanically fastened and/or adhered underlying components (insulation, coverboard or base sheet) and with existing granule-surface BUR or granule-surface SBS or APP modified bitumen cap sheet	None	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied)	-150.0
R-86.	Existing asphaltic roof system with adhered underlying components (insulation, coverboard or base sheet) over monolithic deck and with existing smooth- or granule-surface BUR or granule-surface SBS or APP modified bitumen cap sheet	None	Duro-Fleece or Duro-Fleece Plus / Duro-Fleece CR-20 (splatter applied)	-370.0