


Fasten 6 inches on center with 1-1/4 inch roofing nails. Increase fastener spacing to 3 inches on center at outer corners of roof (10 feet, min).

Any Duro-Last membrane stripping up to 60 mils thick

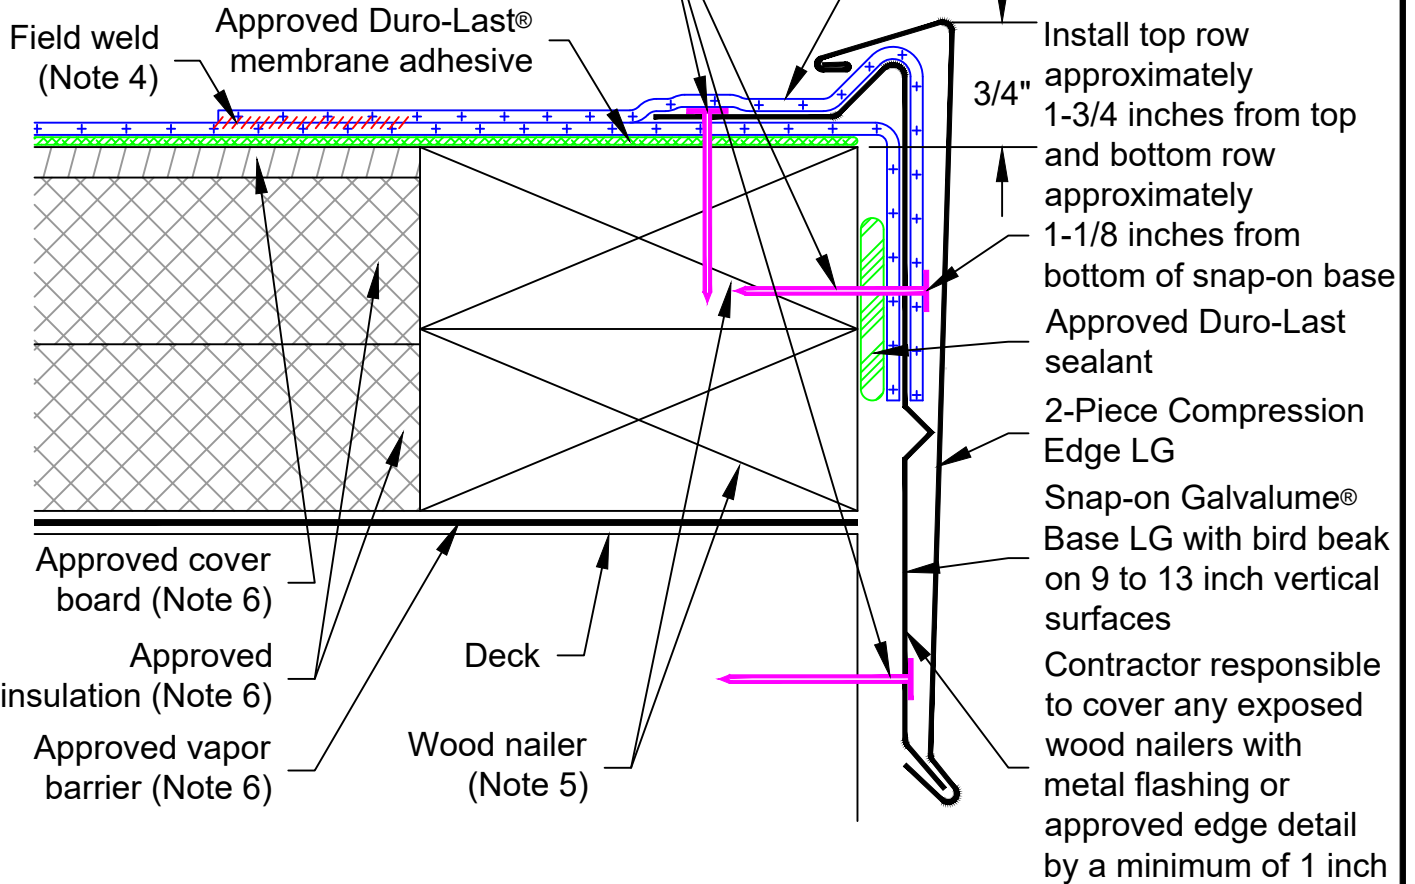

Note 1: This detail may also be used on parapet walls.

Note 2: The use of this detail is not to exceed a 2 inch per 12 inch slope.

Note 3: Allow for 1/8 inch expansion gap between 10 foot lengths of snap-on base. Overlap the snap-on covers by 2 inches between 10 foot lengths.

Note 4: All field welds shall be a minimum of 1-1/2 inches wide.

Note 5: Wood nailers must withstand a minimum force of 180 pounds per lineal foot (per building code). Any pull values greater than 270 pounds will allow for a fastener spacing of 18 inches on center. Pull values less than 270 pounds will require additional fasteners. **The installing contractor is responsible for meeting building codes.**

Note 6: Refer to specifications for vapor barrier, insulation and cover board requirements.

REVISED:	N/A	EDGE DETAIL FOR ADHERED SYSTEMS
PREVIOUS:	09/12/2019	UNIVERSAL 2-PIECE COMPRESSION EDGE LG
SCALE:	NONE	NEW CONSTRUCTION OR RE-ROOF